**Light efficiency:**

**104 Lumen/Watt**

**Light quality:**


**CRI: 94,6**


**Color temperature:**

**2700 K**

**Output: 125 lm**
**Peak: 47,2 cd**

**Power: 1,2 W**
**PF: 1,0**

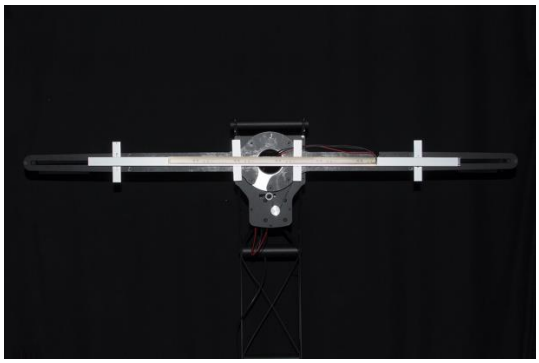

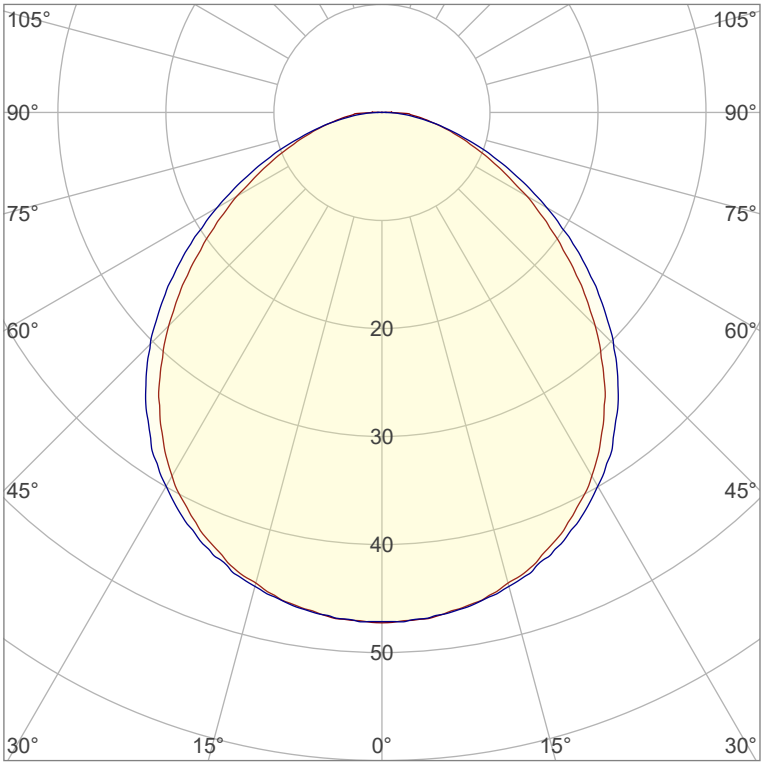


**Product name:**
**Mayflower-3_510mm_927_Cover-Flat-Frosted**


**Item number:**
**NP/L1C/10C/0510/927/CFF**

**Date and time:**
**10.06.2022 13:08:59**


**Description:**
**Tolerances:**
**Lumen +/-4%**
**Candela +/-2,5%**
**Colour Temp +/-35 Kelvin**
**CRI +/-0,7**
**Angular Resolution: 1 Degree Step**
**Last Calibration 20-09-2021**
**Tester: Peter Ulrich**
**Test Site: Lichtlabor**
**Gaustrasse 13**
**55411 Bingen am Rhein**

**CIE 1931**
**x: 0,460**
**y: 0,411**


**Spectra**

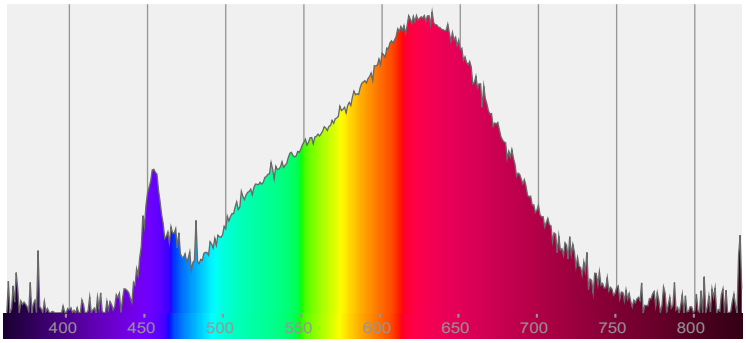



**Power**

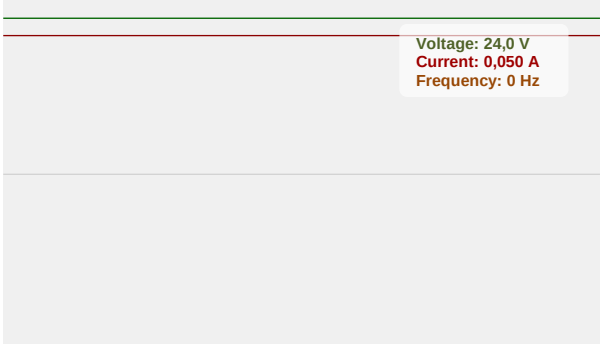


# Color details

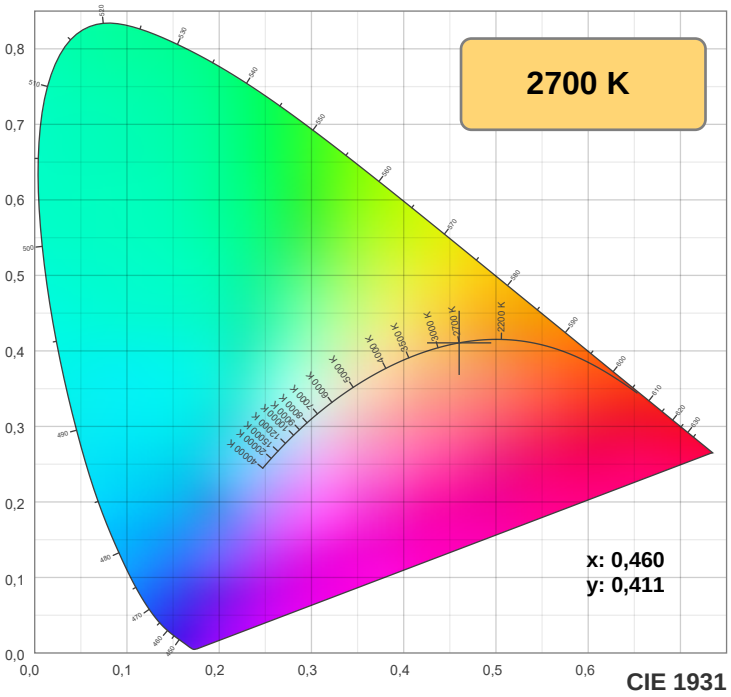


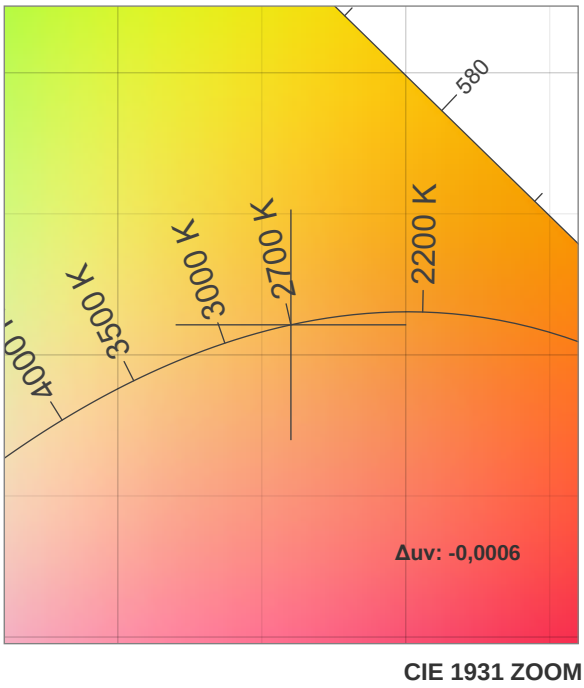
## TM30: 92,2

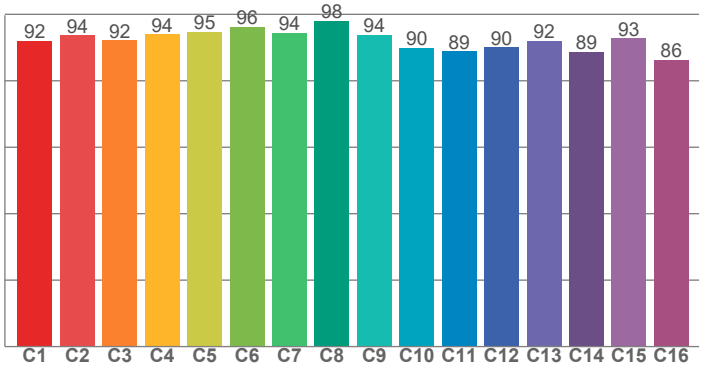


## CRI: 94,6 (R1-R8)

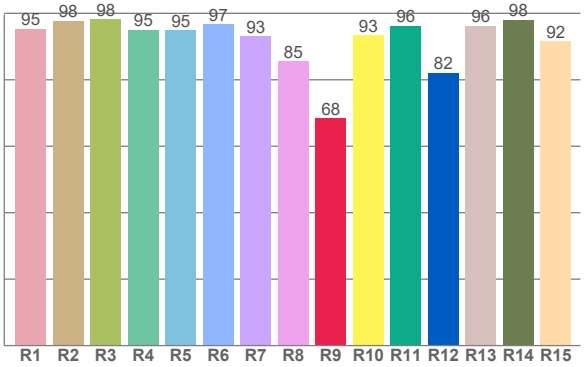


**CRI R values, only R1-R8 are used to calculate final CRI value**

| R1 | R2 | R3 | R4 | R5 | R6 | R7 | R8 | R9 | R10 | R11 | R12 | R13 | R14 | R15 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 95,4 | 97,8 | 98,2 | 95,1 | 94,9 | 96,8 | 93,1 | 85,5 | 68,4 | 93,5 | 96,3 | 82,1 | 96,2 | 98,1 | 91,7 |


**TM30 C values, 16 binned values out of total of 99 C values**

| C1 | C2 | C3 | C4 | C5 | C6 | C7 | C8 | C9 | C10 | C11 | C12 | C13 | C14 | C15 | C16 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 92,1 | 93,7 | 92,1 | 93,9 | 94,8 | 96,2 | 94,5 | 98,0 | 93,8 | 89,8 | 88,9 | 90,0 | 92,1 | 88,7 | 92,8 | 86,3 |

**CQS Q values**

| Q1 | Q2 | Q3 | Q4 | Q5 | Q6 | Q7 | Q8 | Q9 | Q10 | Q11 | Q12 | Q13 | Q14 | Q15 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 89,8 | 95,1 | 89,1 | 88,7 | 92,1 | 93,5 | 91,6 | 92,5 | 97,2 | 94,4 | 93,9 | 93,6 | 93,3 | 89,3 | 89,4 |

## CQS: 91,7

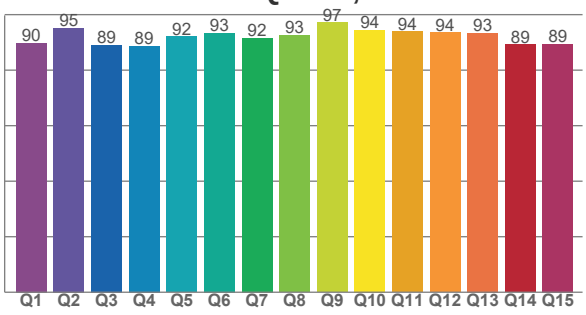


## Color parameters

| Color temperature | Color rendering index | Red component | Color fidelity | Color gamut | Color quality scale | Color coordinate cie 1931 | Color coordinate cie 1931 | Color coordinate | Color coordinate | Color diviation from black body |
|---|---|---|---|---|---|---|---|---|---|---|
| CCT | CRI | CRI R9 | TM30 Rf | TM30 Rg | CQS | x | y | u | v | Δuv |
| 2700 K | 94,6 | 68,4 | 92,2 | 99,6 | 91,7 | 0,460 | 0,411 | 0,263 | 0,352 | -0,0006 |

# TM30 details


**Rf 92,2**


Fidelity index Rf


**Rg 99,6**


Gammut index Rg


| | | Graphic shifts (%) | |
|---|---|---|---|
| Hue Bin | $R_f$ | Chroma | Hue |
| 1 | 92 | -4% | 1% |
| 2 | 94 | -3% | 2% |
| 3 | 92 | -1% | 4% |
| 4 | 94 | -2% | 1% |
| 5 | 95 | -1% | 2% |
| 6 | 96 | 2% | 1% |
| 7 | 94 | -2% | -1% |
| 8 | 98 | -1% | 0% |
| 9 | 94 | -1% | 3% |
| 10 | 90 | 0% | 7% |
| 11 | 89 | 3% | 8% |
| 12 | 90 | 5% | 0% |
| 13 | 92 | 3% | -5% |
| 14 | 89 | 4% | -8% |
| 15 | 93 | -2% | -3% |
| 16 | 86 | -2% | -11% |

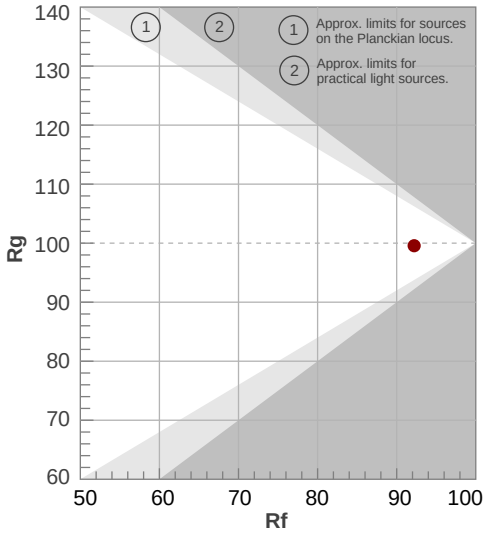


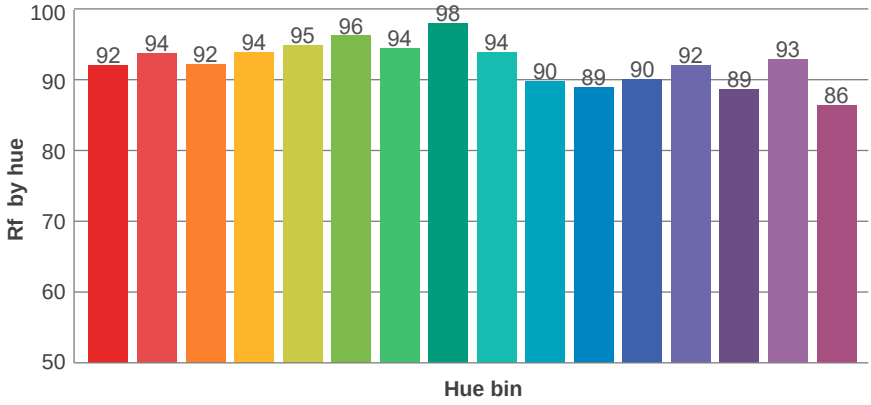


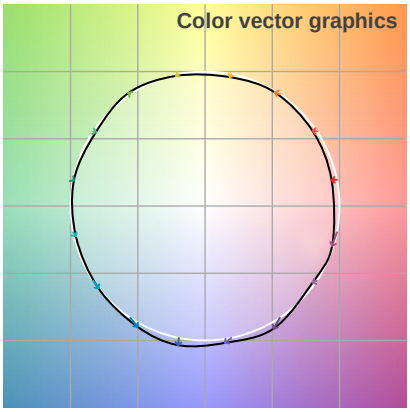
# Beam details

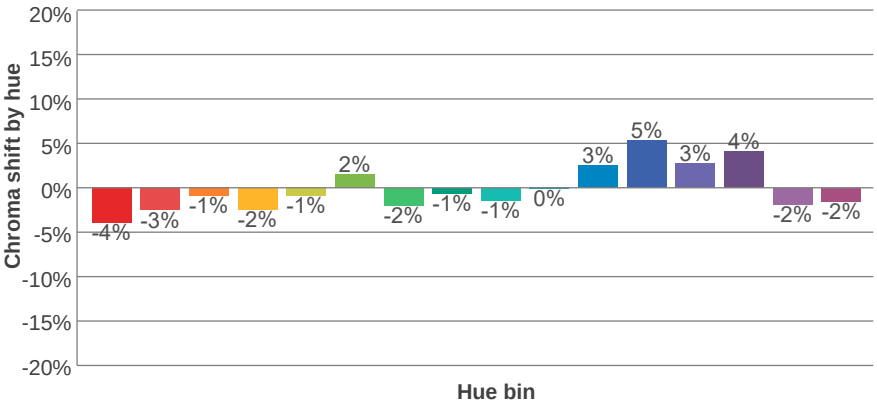

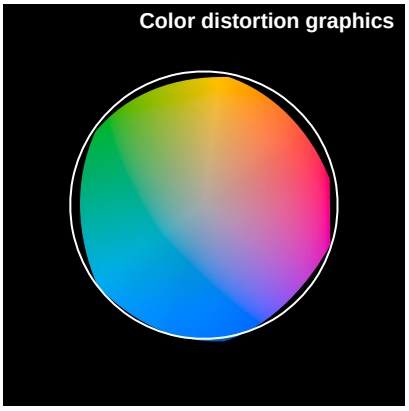
**Beam intensities from 1-20m**
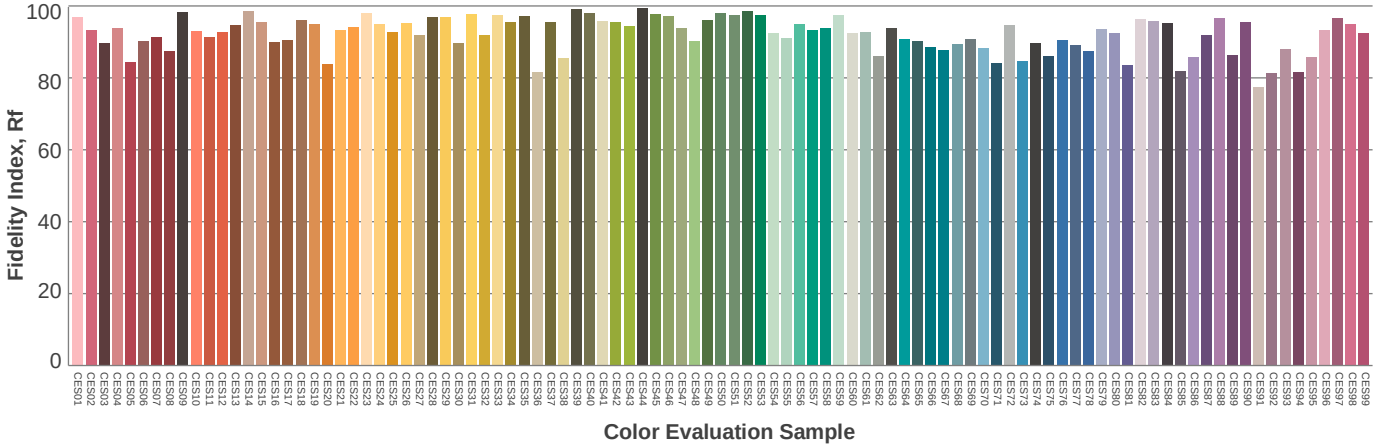
| 1m | 2m | 3m | 4m | 5m | 6m | 7m | 8m | 9m | 10m | 11m | 12m | 13m | 14m | 15m | 16m | 17m | 18m | 19m | 20m |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 3,3ft | 6,6ft | 9,8ft | 13,1ft | 16,4ft | 19,7ft | 23ft | 26,2ft | 29,5ft | 32,8ft | 36,1ft | 39,4ft | 42,7ft | 45,9ft | 49,2ft | 52,5ft | 55,8ft | 59,1ft | 62,3ft | 65,6ft |
| 47lx | 12lx | 5lx | 3lx | 2lx | 1lx | 1lx | 1lx | 1lx | 0lx | 0lx | 0lx | 0lx | 0lx | 0lx | 0lx | 0lx | 0lx | 0lx | 0lx |
| 4,4fcd | 1,1fcd | 0,5fcd | 0,3fcd | 0,2fcd | 0,1fcd | 0,1fcd | 0,1fcd | 0,1fcd | 0fcd | 0fcd | 0fcd | 0fcd | 0fcd | 0fcd | 0fcd | 0fcd | 0fcd | 0fcd | 0fcd |

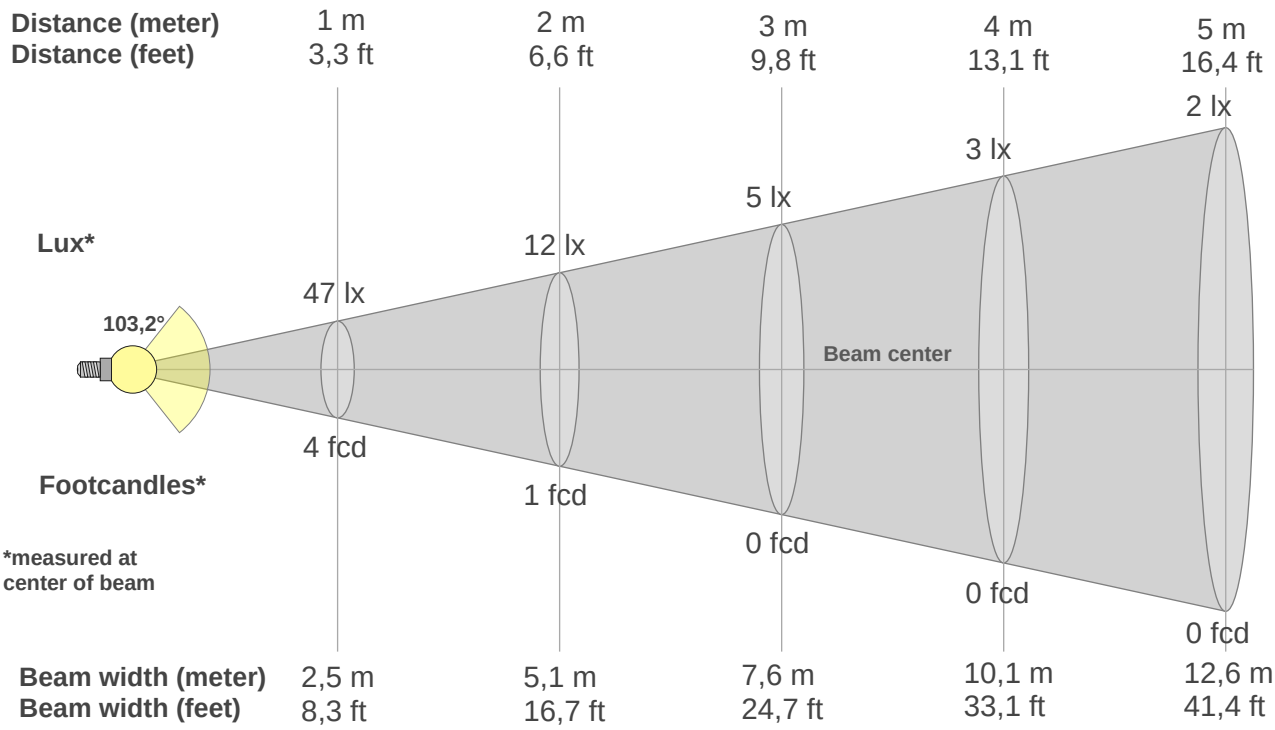**Intensities in 0° c-plane**

| 0° | 5° | 10° | 15° | 20° | 25° | 30° | 35° | 40° | 45° | 50° | 55° | 60° | 65° | 70° | 75° | 80° | 85° | 90° | 95° |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 47,2 | 47,1 | 46,3 | 45,1 | 43,5 | 41,4 | 38,9 | 35,6 | 32,0 | 27,9 | 23,5 | 19,3 | 15,5 | 11,8 | 8,8 | 6,4 | 4,3 | 2,8 | 0,9 | 0,0 |
| 100% | 100% | 98% | 96% | 92% | 88% | 82% | 75% | 68% | 59% | 50% | 41% | 33% | 25% | 19% | 14% | 9% | 6% | 2% | 0% |

**Intensities in 90° c-plane**

| 0° | 5° | 10° | 15° | 20° | 25° | 30° | 35° | 40° | 45° | 50° | 55° | 60° | 65° | 70° | 75° | 80° | 85° | 90° | 95° |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 47,2 | 47,0 | 46,4 | 45,4 | 44,0 | 42,3 | 40,0 | 37,3 | 34,0 | 30,3 | 26,2 | 21,9 | 17,6 | 13,5 | 10,0 | 6,7 | 4,1 | 2,0 | 0,4 | 0,0 |
| 100% | 100% | 98% | 96% | 93% | 90% | 85% | 79% | 72% | 64% | 55% | 46% | 37% | 29% | 21% | 14% | 9% | 4% | 1% | 0% |

**Intensities in 180° c-plane**


| 0° | 5° | 10° | 15° | 20° | 25° | 30° | 35° | 40° | 45° | 50° | 55° | 60° | 65° | 70° | 75° | 80° | 85° | 90° | 95° |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 47,2 | 47,1 | 46,3 | 45,1 | 43,5 | 41,4 | 38,9 | 35,6 | 32,0 | 27,9 | 23,5 | 19,3 | 15,5 | 11,8 | 8,8 | 6,4 | 4,3 | 2,8 | 0,9 | 0,0 |
| 100% | 100% | 98% | 96% | 92% | 88% | 82% | 75% | 68% | 59% | 50% | 41% | 33% | 25% | 19% | 14% | 9% | 6% | 2% | 0% |

**Intensities in 270° c-plane**

| 0° | 5° | 10° | 15° | 20° | 25° | 30° | 35° | 40° | 45° | 50° | 55° | 60° | 65° | 70° | 75° | 80° | 85° | 90° | 95° |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 47,2 | 47,0 | 46,4 | 45,4 | 44,0 | 42,3 | 40,0 | 37,3 | 34,0 | 30,3 | 26,2 | 21,9 | 17,6 | 13,5 | 10,0 | 6,7 | 4,1 | 2,0 | 0,4 | 0,0 |
| 100% | 100% | 98% | 96% | 93% | 90% | 85% | 79% | 72% | 64% | 55% | 46% | 37% | 29% | 21% | 14% | 9% | 4% | 1% | 0% |

| Beam angle 50% | Field angle 10% | Cutoff angle 2,5% | Intensity ratio in 120° cone | Intensity ratio in 90° cone |
|---|---|---|---|---|
| **103,2°** | **158,4°** | **180,2°** | **80,3%** | **56,7%** |

## ISO candela diagram

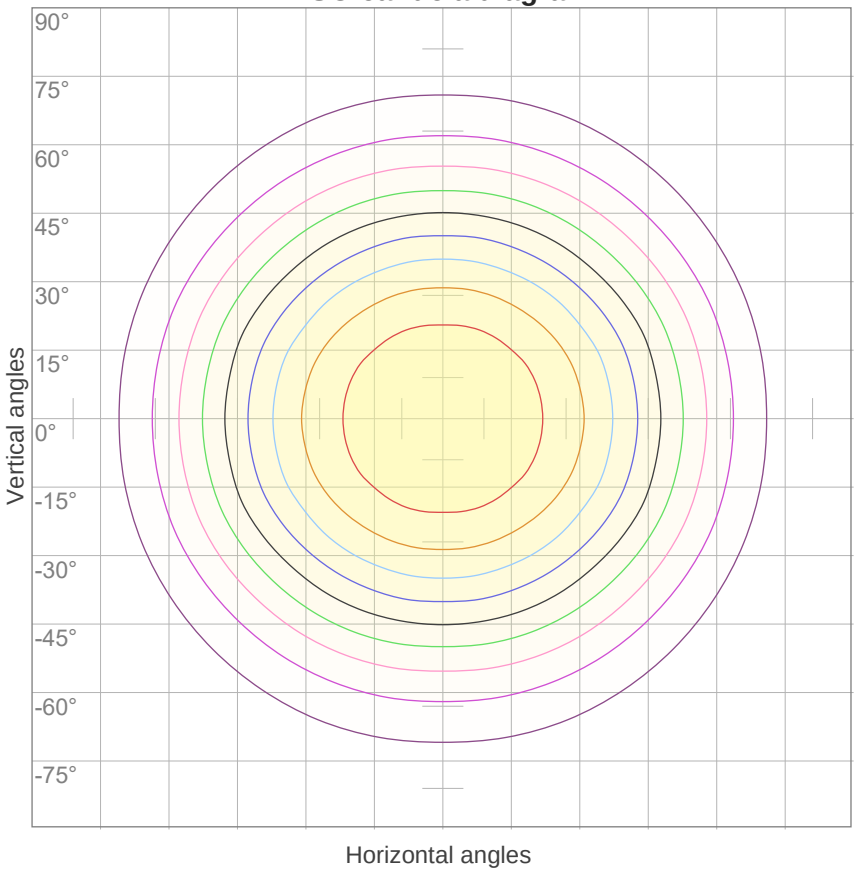



| | |
|---|---|
| 10% | 5 cd |
| 20% | 9 cd |
| 30% | 14 cd |
| 40% | 19 cd |
| 50% | 24 cd |
| 60% | 28 cd |
| 70% | 33 cd |
| 80% | 38 cd |
| 90% | 42 cd |

Conditions:

Number of c-planes: 16

Candela at center: 47 cd

## ISO lux diagram

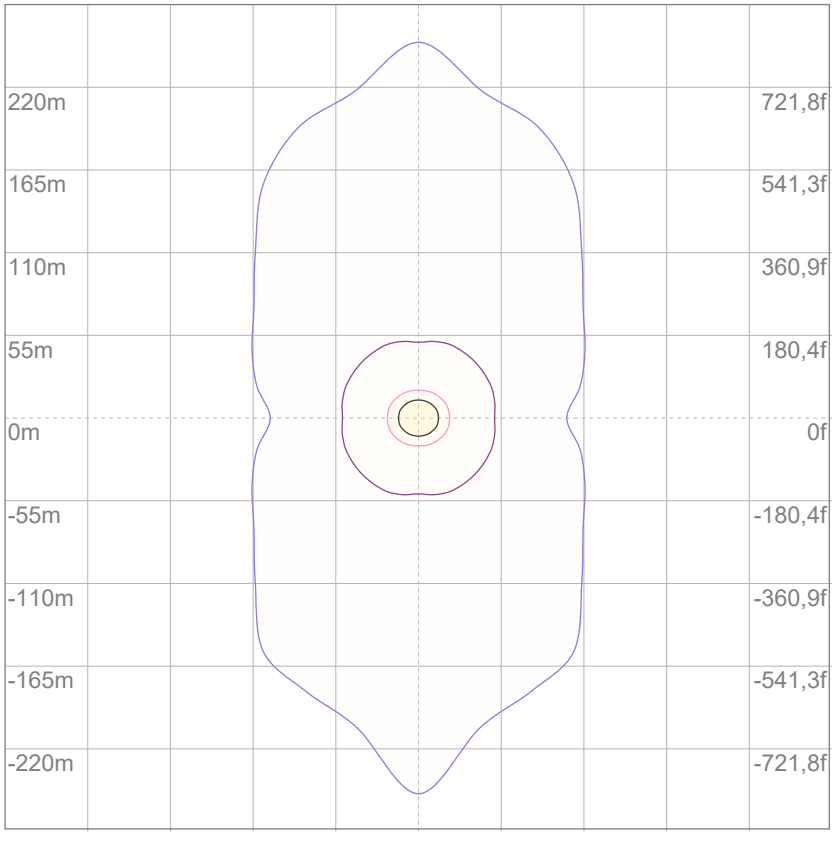


| | |
|---|---|
| 3% | 14,2m lx |
| 5% | 23,6m lx |
| 10% | 47,2m lx |
| 30% | 0,142 lx |
| 50% | 0,236 lx |

Conditions:

Number of c-planes: 16

Lux at center: 0,472 lx

*Lux distribution on a surface when lamp is mounted at 10 meters from the surface.*


## Glare Evaluation According to UGR

| p Ceiling | | 70 | 70 | 50 | 50 | 30 | 70 | 70 | 50 | 50 | 30 |
|---|---|---|---|---|---|---|---|---|---|---|---|
| p Walls | | 50 | 30 | 50 | 30 | 30 | 50 | 30 | 50 | 30 | 30 |
| p Floor | | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 |
| Room size X | Y | Viewing direction at right angles to lamp axis | | | | | Viewing direction parallel to lamp axis | | | | |
| 2H | 2H | 15,3 | 16,5 | 15,5 | 16,8 | 17,0 | 16,3 | 17,5 | 16,6 | 17,8 | 18,0 |
| | 3H | 16,2 | 17,4 | 16,6 | 17,7 | 17,9 | 17,5 | 18,7 | 17,9 | 19,0 | 19,2 |
| | 4H | 16,6 | 17,8 | 17,0 | 18,0 | 18,3 | 18,0 | 19,2 | 18,4 | 19,4 | 19,7 |
| | 6H | 17,0 | 18,0 | 17,3 | 18,3 | 18,7 | 18,4 | 19,4 | 18,7 | 19,7 | 20,1 |
| | 8H | 17,1 | 18,1 | 17,4 | 18,4 | 18,8 | 18,5 | 19,5 | 18,9 | 19,8 | 20,2 |
| | 12H | 17,1 | 18,1 | 17,5 | 18,5 | 18,9 | 18,6 | 19,6 | 19,0 | 19,9 | 20,4 |
| 4H | 2H | 15,8 | 17,0 | 16,2 | 17,2 | 17,5 | 16,7 | 17,8 | 17,1 | 18,1 | 18,4 |
| | 3H | 17,0 | 18,0 | 17,4 | 18,3 | 18,8 | 18,1 | 19,1 | 18,5 | 19,4 | 19,9 |
| | 4H | 17,5 | 18,4 | 17,9 | 18,8 | 19,3 | 18,7 | 19,6 | 19,1 | 20,0 | 20,5 |
| | 6H | 17,9 | 18,7 | 18,4 | 19,1 | 19,5 | 19,2 | 20,0 | 19,7 | 20,4 | 20,7 |
| | 8H | 18,0 | 18,8 | 18,6 | 19,2 | 19,6 | 19,3 | 20,1 | 19,8 | 20,5 | 20,9 |
| | 12H | 18,2 | 18,8 | 18,7 | 19,2 | 19,7 | 19,5 | 20,1 | 20,0 | 20,5 | 21,0 |
| 8H | 4H | 17,7 | 18,5 | 18,2 | 18,9 | 19,3 | 18,8 | 19,6 | 19,3 | 20,0 | 20,3 |
| | 6H | 18,3 | 18,9 | 18,8 | 19,4 | 19,9 | 19,4 | 20,0 | 19,9 | 20,5 | 21,0 |
| | 8H | 18,6 | 19,1 | 19,1 | 19,6 | 20,2 | 19,7 | 20,2 | 20,2 | 20,8 | 21,4 |
| | 12H | 18,8 | 19,2 | 19,4 | 19,7 | 20,3 | 19,9 | 20,4 | 20,5 | 20,9 | 21,5 |
| 12H | 4H | 17,7 | 18,4 | 18,2 | 18,8 | 19,3 | 18,8 | 19,5 | 19,3 | 19,9 | 20,4 |
| | 6H | 18,4 | 18,9 | 18,9 | 19,4 | 20,1 | 19,5 | 20,0 | 20,0 | 20,5 | 21,2 |
| | 8H | 18,7 | 19,1 | 19,2 | 19,6 | 20,2 | 19,8 | 20,2 | 20,4 | 20,7 | 21,3 |
| Variation of the observer position for the luminaire distance S | | | | | | | | | | | |
| S = 1.0H | | 0,1 / -0,2 | | | | | 0,1 / -0,1 | | | | |
| S = 1.5H | | 0,3 / -0,5 | | | | | 0,2 / -0,3 | | | | |
| S = 2.0H | | 0,7 / -0,9 | | | | | 0,7 / -0,8 | | | | |
| Standard table | | n/a | | | | | n/a | | | | |
| Correction summand | | n/a | | | | | n/a | | | | |
| Corrected glare indices referring to 125 lm total luminous flux | | | | | | | | | | | |

## Coefficients of Utilization

| Ceiling reflectance | 80 | | | | 70 | | | | 50 | | | 30 | | | 10 | | | 0 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Wall reflectance | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| Floor reflectance | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 0 |
| RCR | (RCR: Room Cavity Ratio) | | | | Room Values are expressed as percentage of Lumens delivered to the task surface | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 110 | 110 | 110 | 105 | 105 | 105 | 101 | 101 | 101 | 99 |
| 1 | 109 | 104 | 100 | 96 | 106 | 102 | 98 | 94 | 97 | 94 | 91 | 93 | 90 | 88 | 89 | 87 | 85 | 83 |
| 2 | 99 | 91 | 85 | 79 | 96 | 89 | 83 | 78 | 85 | 80 | 76 | 82 | 78 | 74 | 79 | 75 | 72 | 70 |
| 3 | 91 | 80 | 73 | 66 | 88 | 79 | 71 | 66 | 76 | 69 | 64 | 73 | 67 | 63 | 70 | 66 | 62 | 59 |
| 4 | 83 | 72 | 63 | 57 | 81 | 70 | 62 | 56 | 68 | 61 | 55 | 65 | 59 | 54 | 63 | 58 | 53 | 51 |
| 5 | 77 | 64 | 55 | 49 | 75 | 63 | 55 | 49 | 61 | 53 | 48 | 59 | 52 | 47 | 57 | 51 | 47 | 45 |
| 6 | 71 | 58 | 49 | 43 | 69 | 57 | 49 | 43 | 55 | 48 | 42 | 53 | 47 | 42 | 51 | 46 | 41 | 39 |
| 7 | 66 | 53 | 44 | 38 | 64 | 52 | 44 | 38 | 50 | 43 | 37 | 49 | 42 | 37 | 47 | 41 | 37 | 35 |
| 8 | 61 | 48 | 40 | 34 | 60 | 47 | 39 | 34 | 46 | 39 | 34 | 45 | 38 | 33 | 43 | 37 | 33 | 31 |
| 9 | 57 | 44 | 36 | 31 | 56 | 44 | 36 | 31 | 42 | 35 | 30 | 41 | 35 | 30 | 40 | 34 | 30 | 28 |
| 10 | 54 | 41 | 33 | 28 | 53 | 40 | 33 | 28 | 39 | 32 | 28 | 38 | 32 | 27 | 37 | 31 | 27 | 25 |

## Luminaire budgetary diagram

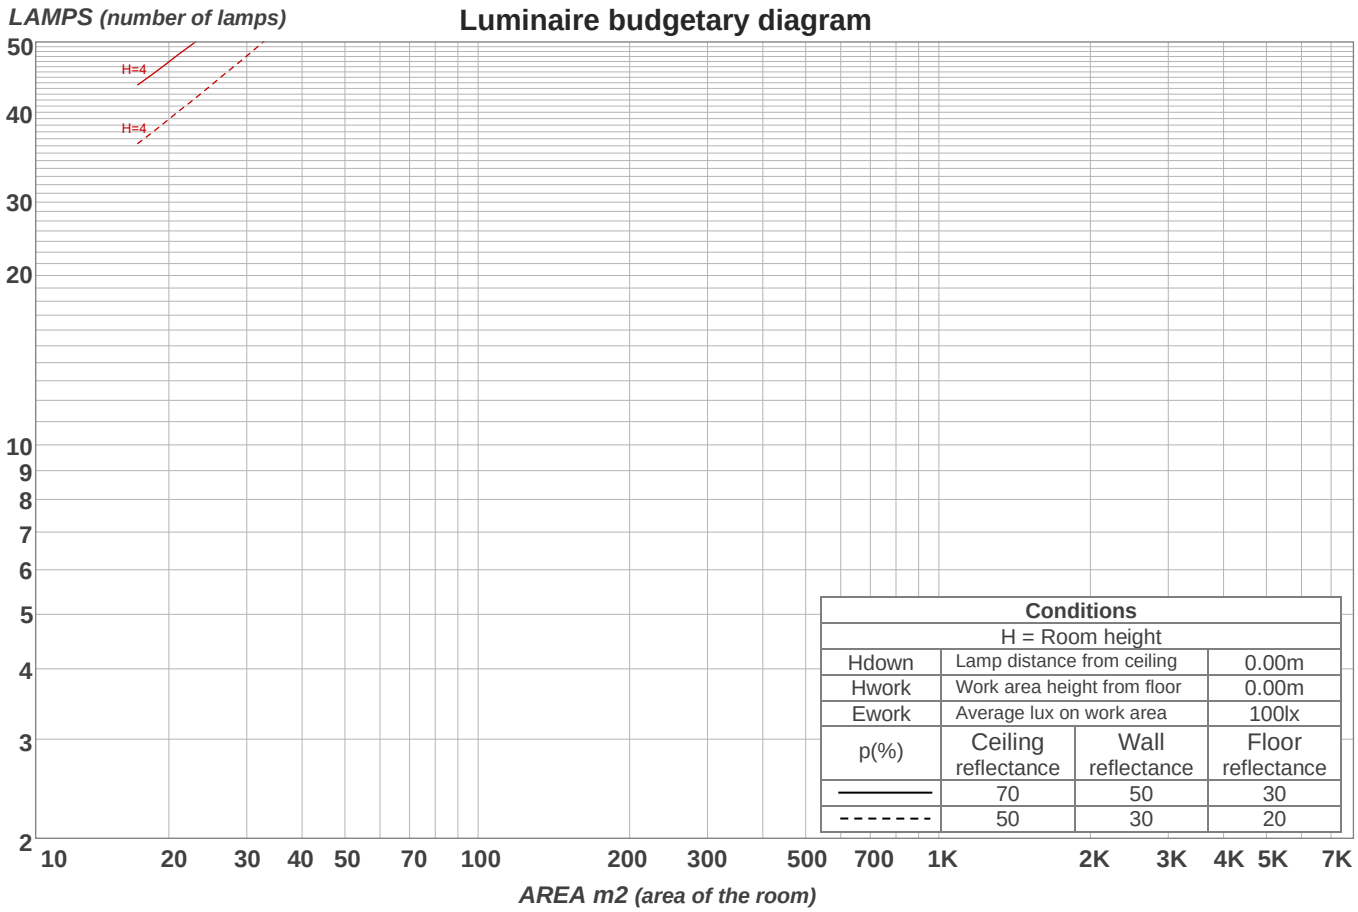



## Zonal Lumen Summary

| 0°-10° | 10°-20° | 20°-30° | 30°-40° | 40°-50° | 50°-60° | 60°-70° | 70°-80° | 80°-90° |
|---|---|---|---|---|---|---|---|---|
| 4,47 lm | 12,8 lm | 19,3 lm | 22,8 lm | 22,5 lm | 18,5 lm | 12,8 lm | 7,15 lm | 2,86 lm |

| 90°-100° | 100°-110° | 110°-120° | 120°-130° | 130°-140° | 140°-150° | 150°-160° | 160°-170° | 170°-180° |
|---|---|---|---|---|---|---|---|---|
| 0,838 lm | 0,221 lm | 0,186 lm | 0,168 lm | 0,145 lm | 0,118 lm | 0,087 lm | 0,053 lm | 0,018 lm |

## Warmup curve

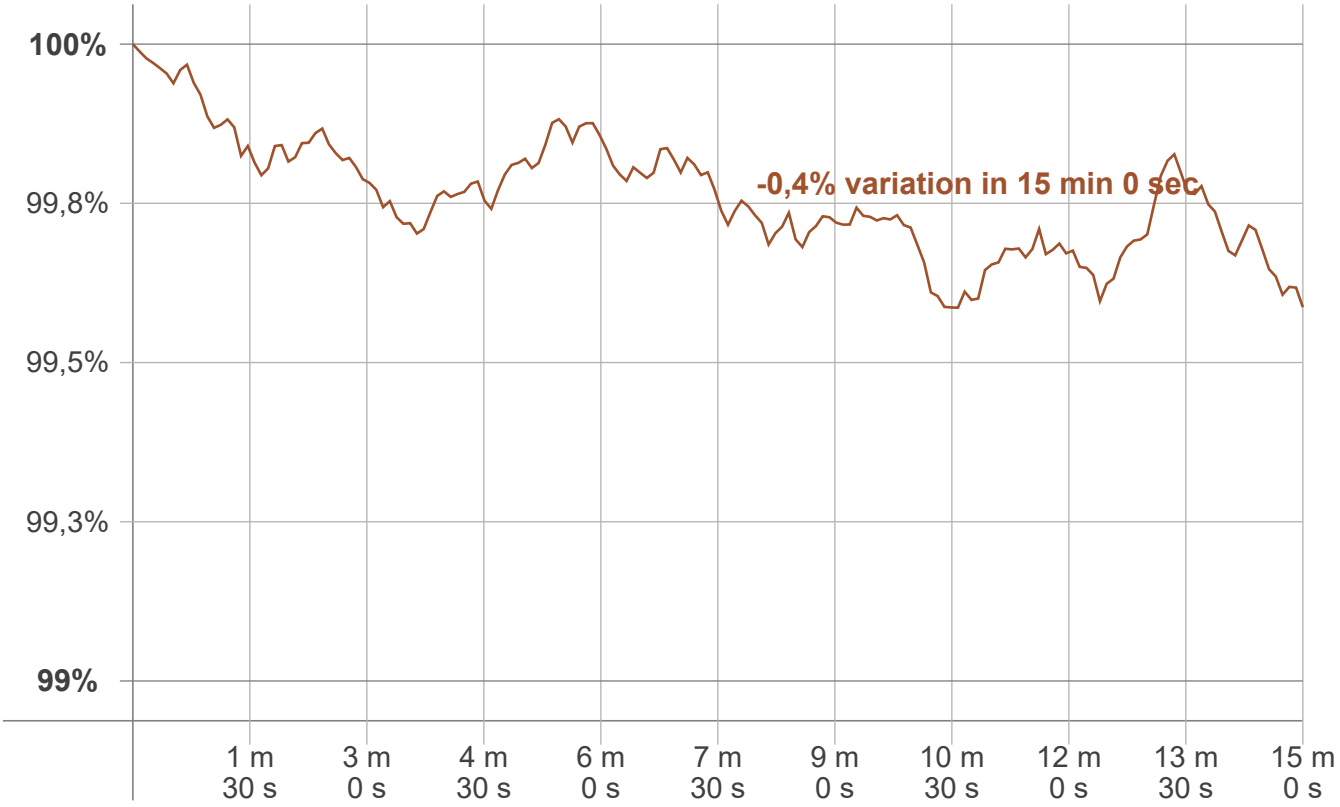


## Warmup result

| | |
|---|---|
| **Warmup time:** | **Lamp stabilized in 15 min 0 sec** |
| **Warmup variation** | **-0,4%** |

## Warmup conditions

| | |
|---|---|
| **Stable period:** | **15 min** |
| **Stable change max:** | **2,0%** |
| **Minimum time:** | **15 min** |

## Color temperature change

| CCT start | CCT change | CCT end |
|---|---|---|
| 2695 K | +5 K | 2700 K |

## Output change

| Output start | Output change | Output end |
|---|---|---|
| 125 lm | lm | 125 lm |