

Light efficiency:

113 Lumen/Watt

Light quality:

CRI: 94,2

Color temperature:


2732 K

Output: 1300 lm

Peak: 1182 cd

Power: 11,5 W

PF: 1,0

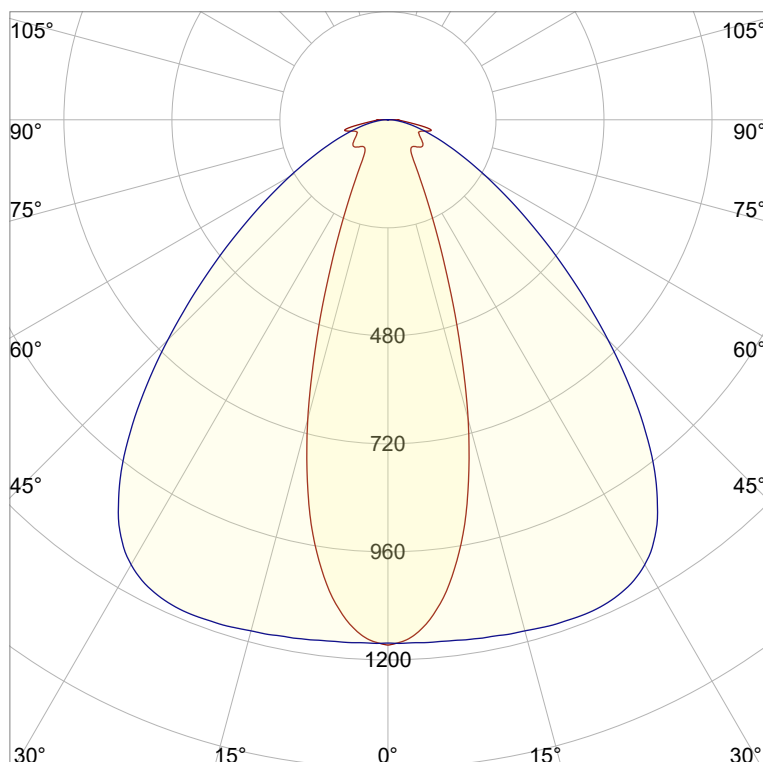

Product name:

Jago-2_510mm_927_Lens-30°-Frosted

Item number:

NP/L1C/19B/G1/L1C/0510/927/L3F

Date and time:

21.07.2022 12:56:59

Description:

Rank: C80-AD-8GB

Tolerances:

Lumen +/-4%

Candela +/-2,5%

Colour Temp +/-35 Kelvin

CRI +/-0,7

Angular Resolution: 1 Degree Step

Last Calibration 20-09-2021

Tester: Peter Ulrich

Test Site: Lichtlabor

Gaustrasse 13

55411 Bingen am Rhein




CIE 1931

x: 0,456



y: 0,407

Spectra

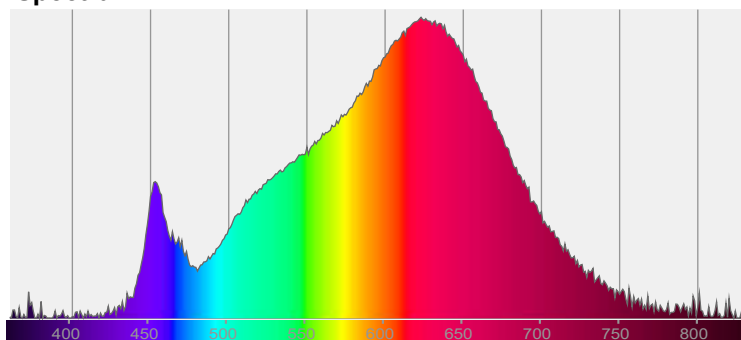


Power


Voltage: 48,0 V
Current: 0,240 A
Frequency: 0 Hz

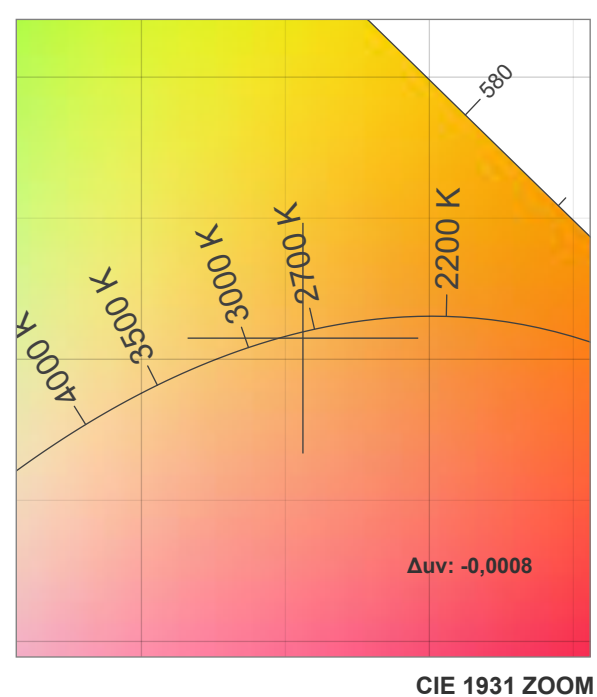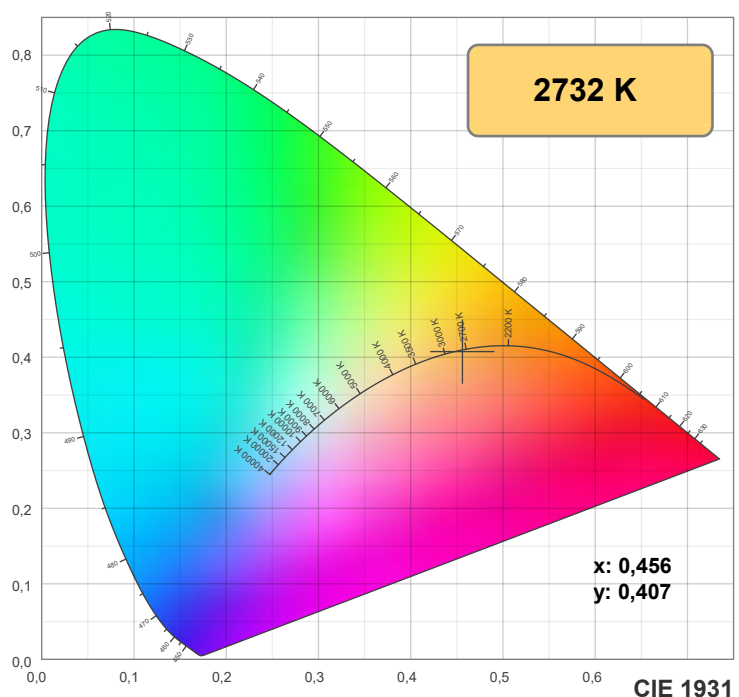

TM30: 92,1

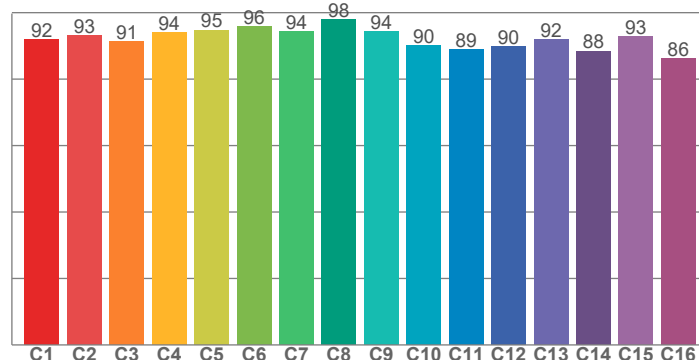

CRI: 94,2 (R1-R8)

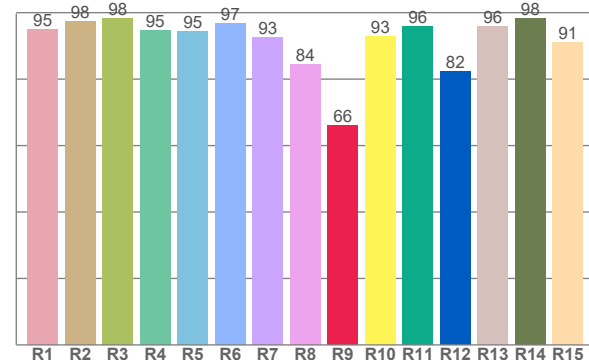

CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
94,9	97,5	98,2	94,7	94,5	96,7	92,7	84,4	66,0	92,9	95,8	82,4	95,8	98,2	91,0


TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
91,8	93,2	91,2	94,0	94,8	95,7	94,4	98,0	94,4	90,2	88,9	89,9	91,9	88,5	92,9	86,2

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
89,4	95,2	88,8	88,5	91,9	92,9	90,8	91,9	97,1	94,0	93,4	92,9	92,8	88,6	88,7

CQS: 91,3

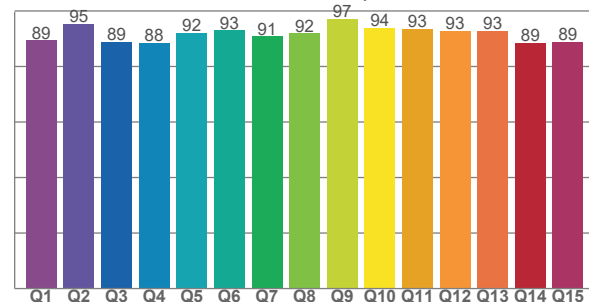

Color parameters

Color temperature	Color rendering index	Red component	Color fidelity	Color gamut	Color quality scale	Color coordinate cie 1931	Color coordinate cie 1931	Color coordinate	Color coordinate	Color deviation from black body
CCT	CRI	CRI R9	TM30 Rf	TM30 Rg	CQS	x	y	u	v	Δuv
2732 K	94,2	66,0	92,1	99,8	91,3	0,456	0,407	0,261	0,350	-0,0008







Rf 92,1


Fidelity index Rf

Rg 99,8

Gammut index Rg

Hue Bin	R _f	Graphic shifts (%)	
		Chroma	Hue
1	92	-4%	0%
2	93	-3%	2%
3	91	-1%	4%
4	94	-2%	1%
5	95	0%	2%
6	96	2%	0%
7	94	-2%	-1%
8	98	-1%	0%
9	94	-2%	3%
10	90	0%	6%
11	89	2%	8%
12	90	5%	1%
13	92	3%	-5%
14	88	4%	-8%
15	93	-2%	-3%
16	86	-2%	-11%

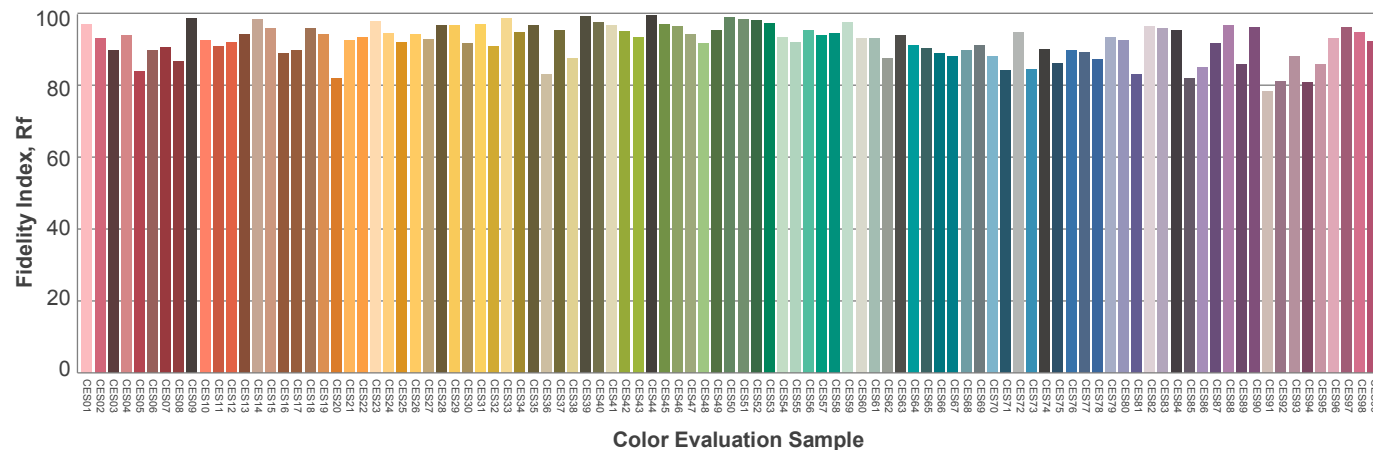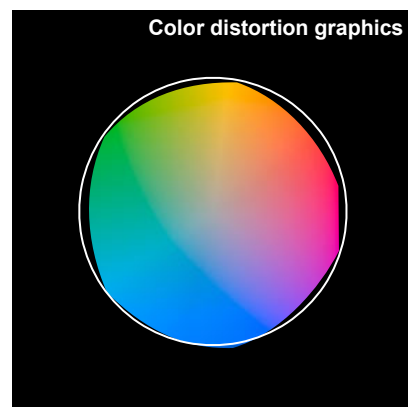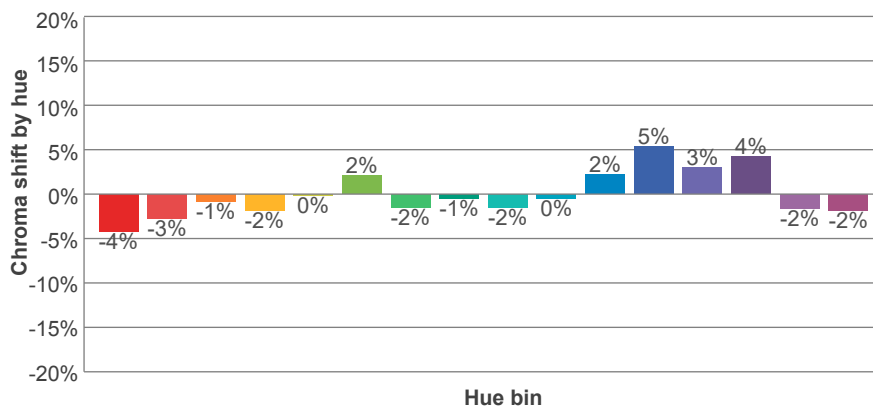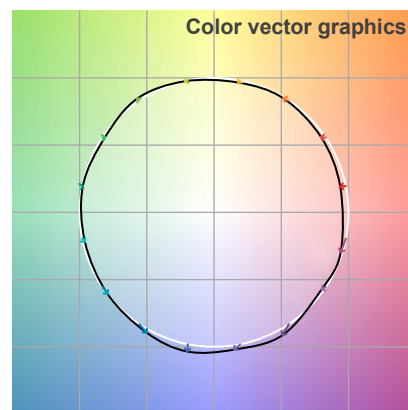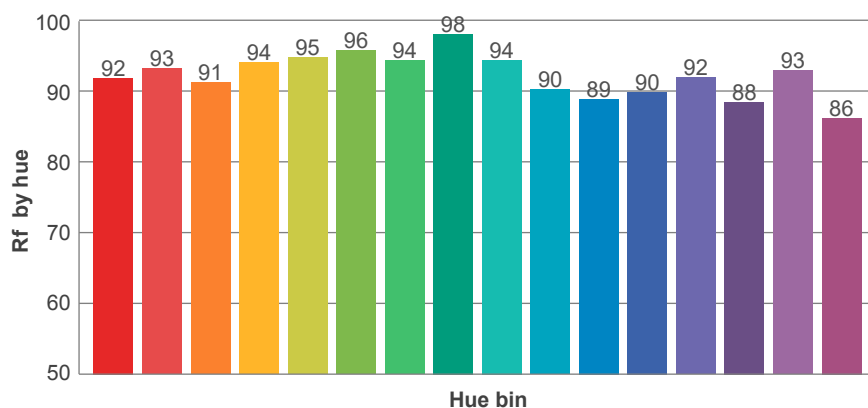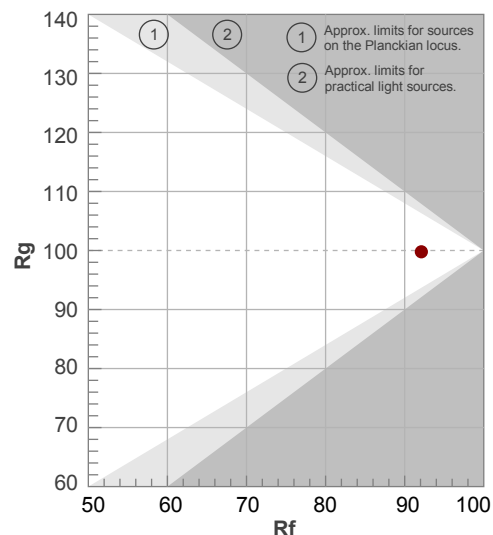

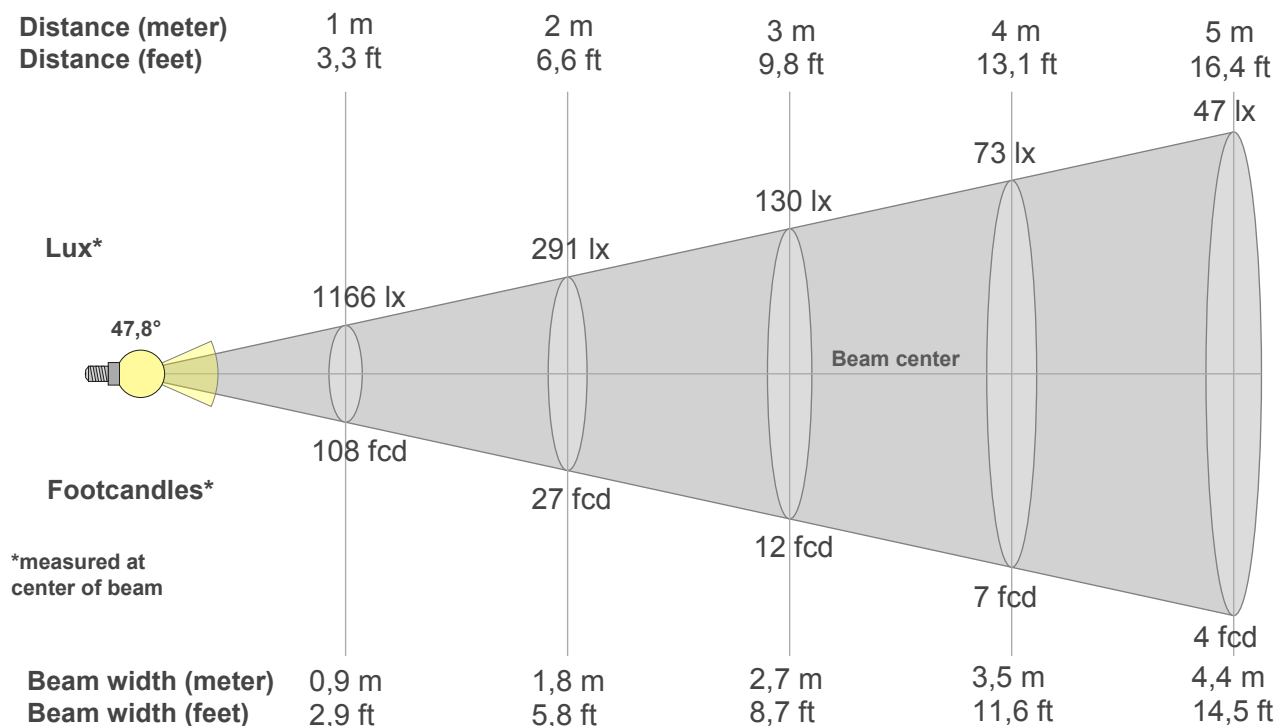

Beam intensities from 1-20m

1m	2m	3m	4m	5m	6m	7m	8m	9m	10m	11m	12m	13m	14m	15m	16m	17m	18m	19m	20m
3,3ft	6,6ft	9,8ft	13,1ft	16,4ft	19,7ft	23ft	26,2ft	29,5ft	32,8ft	36,1ft	39,4ft	42,7ft	45,9ft	49,2ft	52,5ft	55,8ft	59,1ft	62,3ft	65,6ft
1166lx	291lx	130lx	73lx	47lx	32lx	24lx	18lx	14lx	12lx	10lx	8lx	7lx	6lx	5lx	5lx	4lx	4lx	3lx	3lx
108,3fcd	27,1fcd	12fcd	6,8fcd	4,3fcd	3fcd	2,2fcd	1,7fcd	1,3fcd	1,1fcd	0,9fcd	0,8fcd	0,6fcd	0,6fcd	0,5fcd	0,4fcd	0,4fcd	0,3fcd	0,3fcd	0,3fcd

Intensities in 0° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°
1166	1156	1129	1085	1023	946	852	744	628	512	407	320	251	198	159	130	109	95	87	83
100%	99%	97%	93%	88%	81%	73%	64%	54%	44%	35%	27%	22%	17%	14%	11%	9%	8%	7%	7%

Intensities in 90° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°
1166	1163	1164	1165	1167	1170	1172	1175	1177	1181	1182	1182	1180	1173	1161	1141	1111	1071	1016	953
100%	100%	100%	100%	100%	100%	101%	101%	101%	101%	101%	101%	101%	101%	100%	98%	95%	92%	87%	82%

Intensities in 180° c-plane


0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°
1166	1156	1129	1085	1023	946	852	744	628	512	407	320	251	198	159	130	109	95	87	83
100%	99%	97%	93%	88%	81%	73%	64%	54%	44%	35%	27%	22%	17%	14%	11%	9%	8%	7%	7%

Intensities in 270° c-plane

0°	2°	4°	6°	8°	10°	12°	14°	16°	18°	20°	22°	24°	26°	28°	30°	32°	34°	36°	38°
1166	1163	1164	1165	1167	1170	1172	1175	1177	1181	1182	1182	1180	1173	1161	1141	1111	1071	1016	953
100%	100%	100%	100%	100%	100%	101%	101%	101%	101%	101%	101%	101%	101%	100%	98%	95%	92%	87%	82%

Beam angle 50%	Field angle 10%	Cutoff angle 2,5%	Intensity ratio in 120° cone	Intensity ratio in 90° cone
47,8°	81,3°	174,3°	83,5%	68,7%

ISO candela diagram

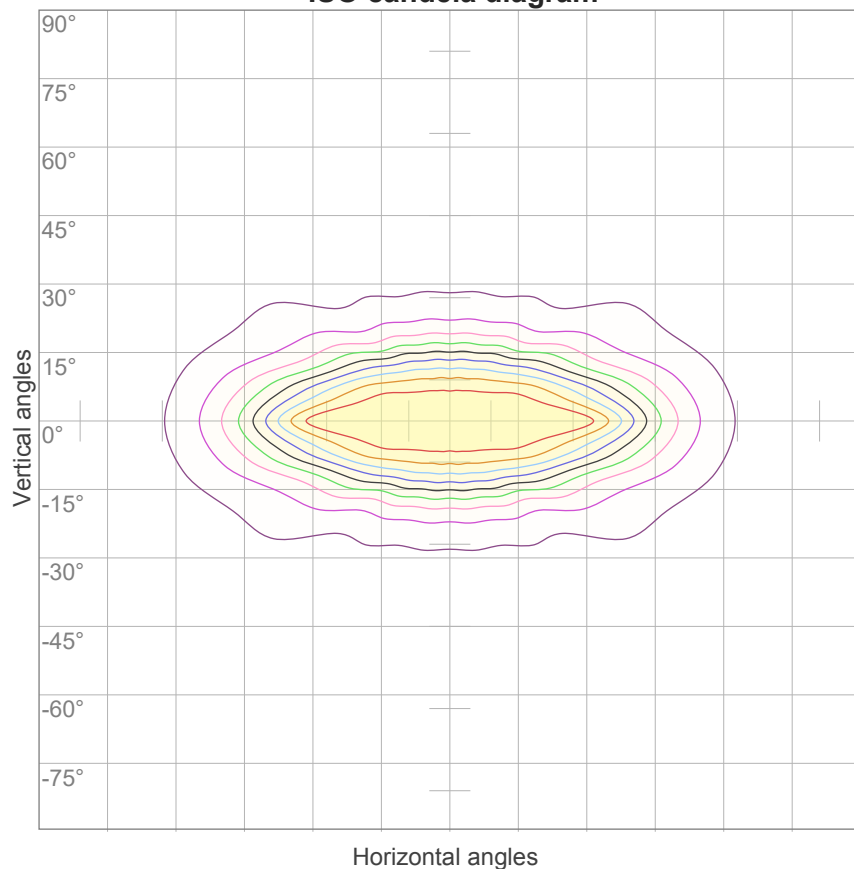


10%	117 cd
20%	233 cd
30%	350 cd
40%	466 cd
50%	583 cd
60%	699 cd
70%	816 cd
80%	932 cd
90%	1049 cd

Conditions:

Number of c-planes: 16

Candela at center: 1166 cd

ISO lux diagram

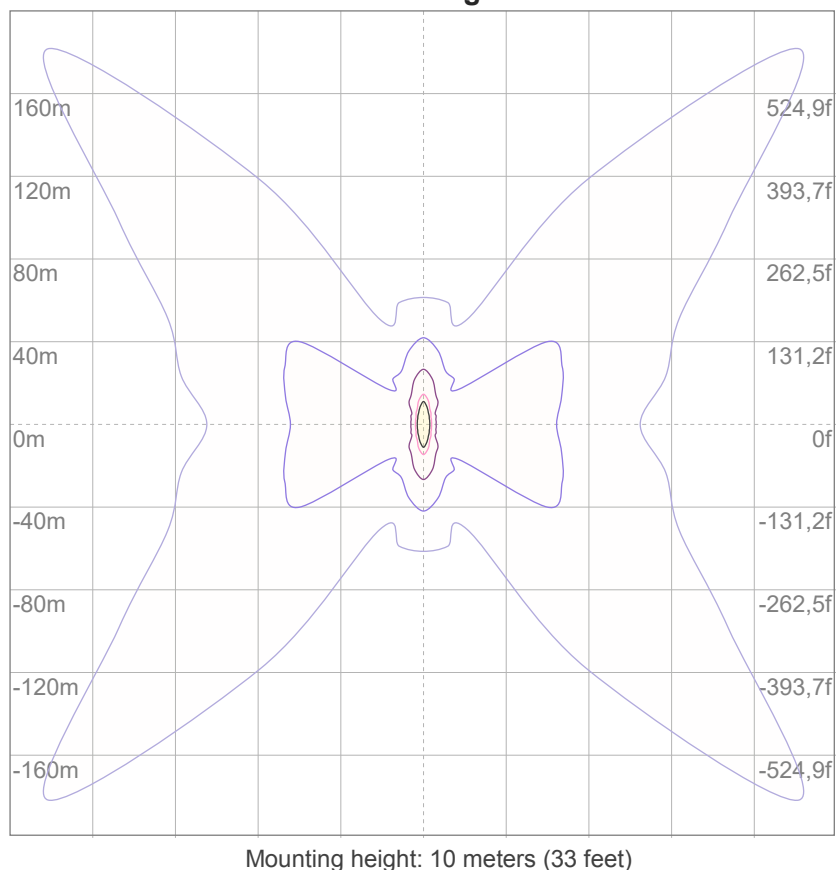

3%	0,350 lx
5%	0,583 lx
10%	1,17 lx
30%	3,50 lx
50%	5,83 lx

Conditions:

Number of c-planes: 16

Lux at center: 11,7 lx

*Lux distribution on a surface
when lamp is mounted at 10
meters from the surface.*

Glare Evaluation According to UGR


p Ceiling		70	70	50	50	30	70	70	50	50	30
p Walls		50	30	50	30	30	50	30	50	30	30
p Floor		20	20	20	20	20	20	20	20	20	20
Room size X Y		Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis				
2H	2H	16,6	17,6	16,8	17,8	18,0	24,6	25,6	24,8	25,8	26,0
	3H	18,7	19,8	19,1	20,0	20,2	25,3	26,4	25,7	26,6	26,8
	4H	20,4	21,5	20,9	21,7	22,0	25,7	26,7	26,1	27,0	27,2
	6H	22,2	23,0	22,5	23,3	23,7	26,0	26,9	26,3	27,2	27,6
	8H	22,5	23,4	22,8	23,7	24,1	26,1	27,0	26,4	27,3	27,7
	12H	22,7	23,5	23,0	23,8	24,3	26,1	27,0	26,5	27,3	27,8
4H	2H	17,3	18,4	17,7	18,6	18,9	24,3	25,4	24,7	25,6	25,9
	3H	19,8	20,6	20,1	21,0	21,4	25,3	26,2	25,7	26,5	27,0
	4H	21,6	22,4	22,1	22,8	23,4	25,7	26,5	26,1	26,9	27,4
	6H	23,5	24,3	24,0	24,6	25,0	26,1	26,8	26,6	27,2	27,6
	8H	23,9	24,6	24,4	25,0	25,3	26,2	26,9	26,7	27,3	27,7
	12H	24,1	24,7	24,6	25,1	25,6	26,3	26,9	26,8	27,3	27,8
8H	4H	22,1	22,8	22,6	23,1	23,5	25,7	26,4	26,2	26,8	27,2
	6H	24,2	24,7	24,7	25,2	25,7	26,2	26,8	26,7	27,2	27,8
	8H	24,8	25,2	25,3	25,7	26,4	26,5	26,9	27,0	27,5	28,1
	12H	25,1	25,5	25,7	26,0	26,6	26,7	27,1	27,3	27,6	28,2
12H	4H	22,1	22,7	22,6	23,1	23,6	25,7	26,3	26,2	26,7	27,2
	6H	24,3	24,8	24,9	25,3	25,9	26,3	26,8	26,8	27,3	27,9
	8H	25,0	25,3	25,5	25,9	26,5	26,6	27,0	27,2	27,5	28,1
Variation of the observer position for the luminaire distance S											
S = 1.0H		0,1 / 0,0					1,0 / -0,9				
S = 1.5H		0,1 / -0,1					2,2 / -1,7				
S = 2.0H		0,2 / -0,1					3,5 / -2,4				
Standard table		n/a					n/a				
Correction summand		n/a					n/a				
Corrected glare indices referring to 1300 lm total luminous flux											

Coefficients of Utilization

Ceiling reflectance	80				70				50			30			10			0
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio) Room Values are expressed as percentage of Lumens delivered to the task surface																	
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	100	100	100	98
1	110	105	101	98	107	103	99	96	98	95	93	94	92	90	90	88	87	85
2	101	94	88	84	99	92	87	82	89	84	80	85	81	78	82	79	76	74
3	94	85	78	73	92	84	77	72	81	75	71	78	73	69	75	71	68	66
4	88	78	70	65	86	76	69	64	74	68	63	71	66	62	69	65	61	59
5	82	71	64	58	80	70	63	58	68	62	57	66	60	56	64	59	55	54
6	77	66	58	53	75	65	58	52	63	57	52	61	56	51	60	55	51	49
7	73	61	54	48	71	60	53	48	59	52	48	57	51	47	56	51	47	45
8	69	57	50	44	67	56	49	44	55	48	44	54	48	44	52	47	43	42
9	65	53	46	41	64	53	46	41	51	45	41	50	45	41	49	44	40	39
10	62	50	43	38	60	49	43	38	48	42	38	47	42	38	46	41	38	36

LAMPS (number of lamps)


Luminaire budgetary diagram

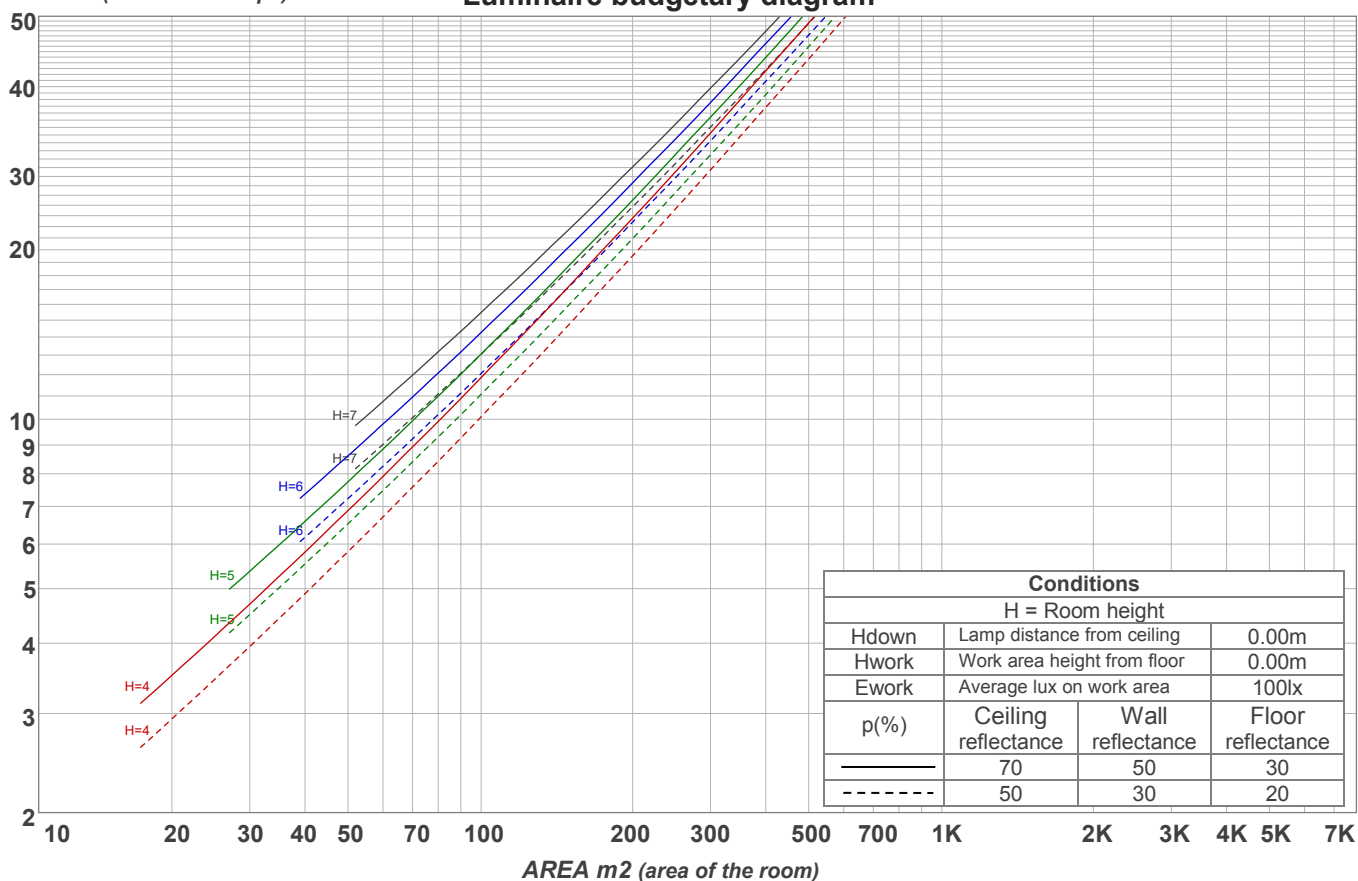

Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
104 lm	250 lm	257 lm	203 lm	154 lm	118 lm	84,0 lm	67,5 lm	39,4 lm
90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
5,72 lm	5,99 lm	3,50 lm	1,68 lm	0,642 lm	0,521 lm	0,384 lm	0,235 lm	4,90 lm

Warmup curve

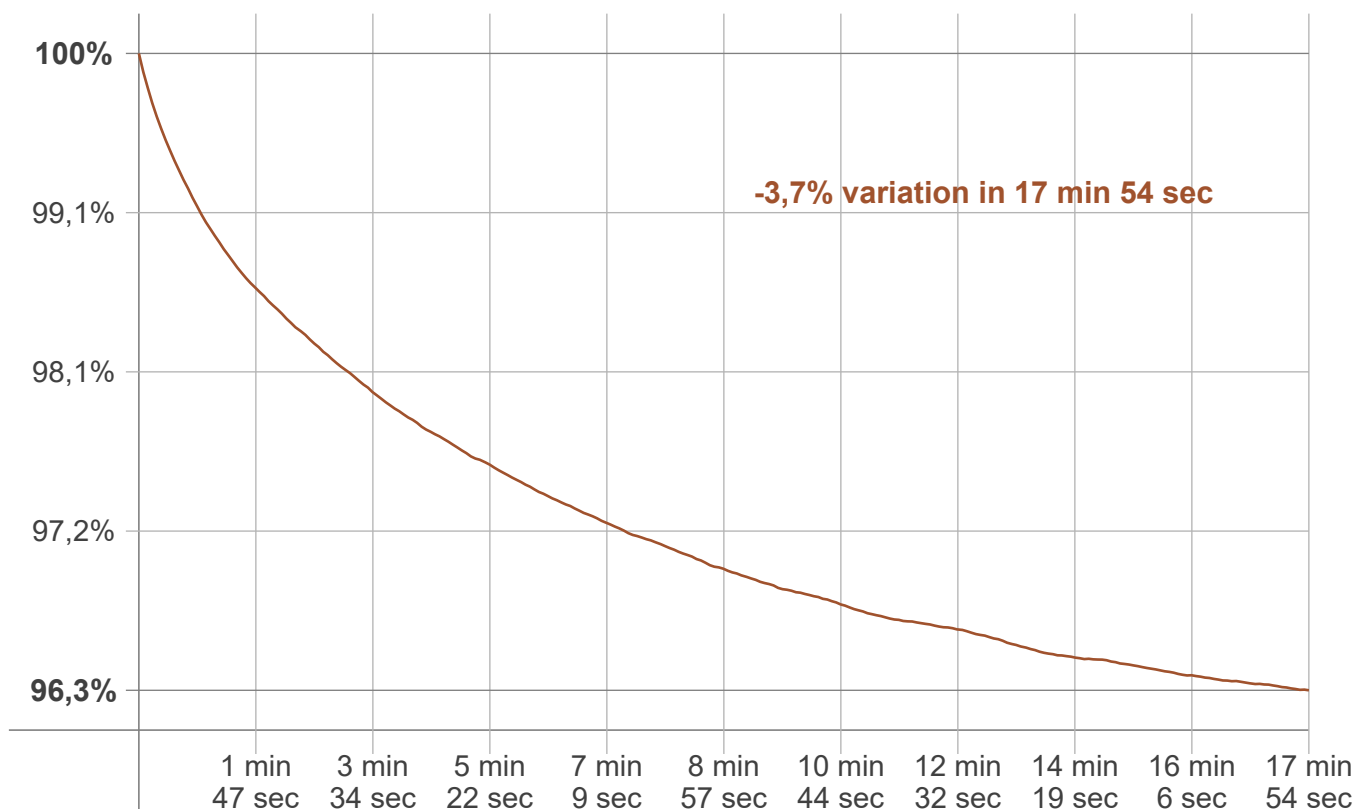

Warmup result

Warmup time:	Lamp stabilized in 17 min 54 sec
Warmup variation	-3,7%

Warmup conditions

Stable period:	15 min
Stable change max:	2,0%
Minimum time:	15 min

Color temperature change

CCT start	CCT change	CCT end
2738 K	-6 K	2732 K

Output change

Output start	Output change	Output end
1345 lm	-45 lm	1300 lm