Light efficiency:

55 Lumen/Watt

Light quality:


CRI: 0,0


Color temperature:

0 K

Output: 424 lm
Peak: 110 cd

Power: 7,7 W
PF: 1,0

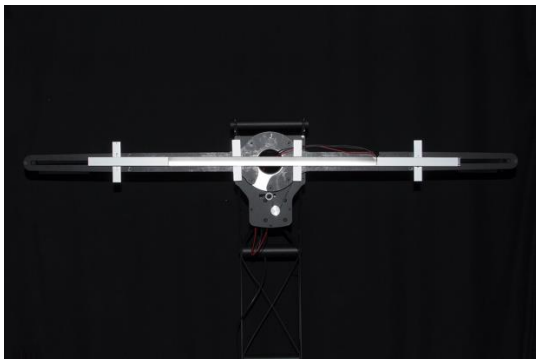

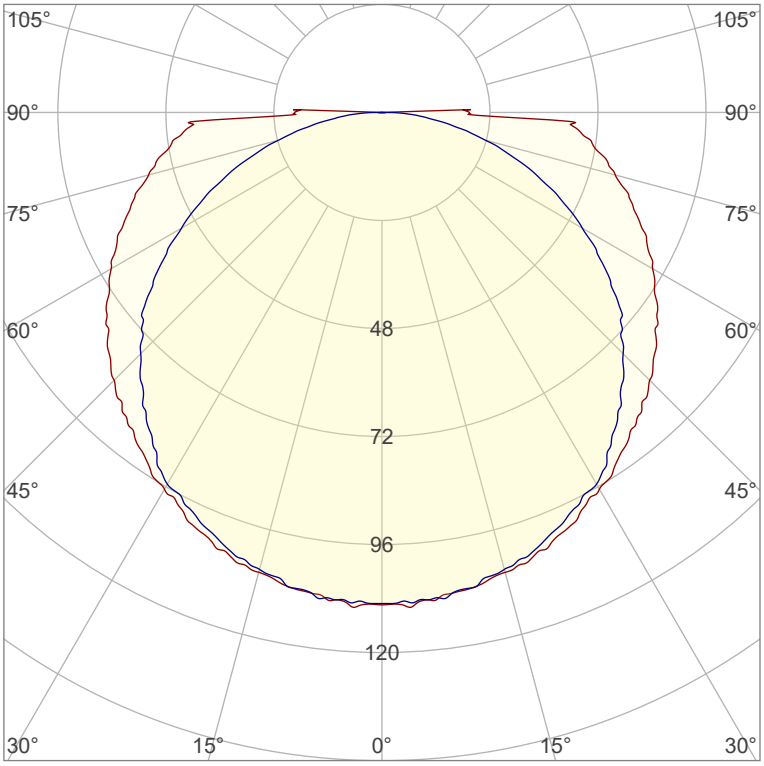

Product name:
Defiant-3_510mm_XXG_Cover-Round-White


Item number:
NP/L3C/22C/0510/XXG/CRW

Date and time:
29.06.2020 09:54:07


Description:
Toleranzen:
Lumen +/-4%
Candela +/-2,5%
Colour Temp +/-35 K
CRI +/-0,7
Angular Resolution 1 Grad Step
Last Calibration 20.05.2020
Pruefer:
Peter Ulrich
Pruefort:
Lichtlabor
Gaustrasse 13
55411 Bingen am Rhein

CIE 1931
x: 0,202
y: 0,713


Spectra

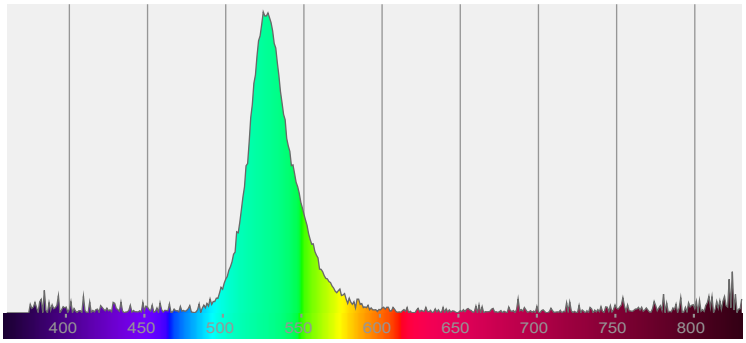


Power

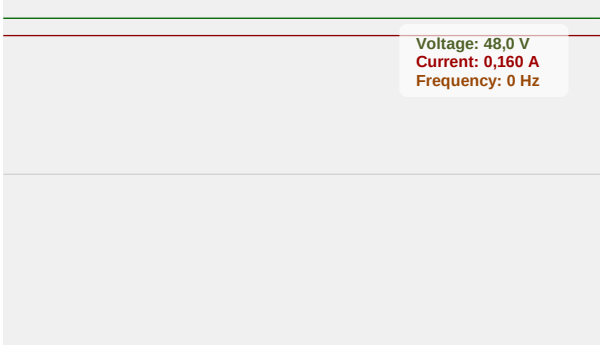

Color details

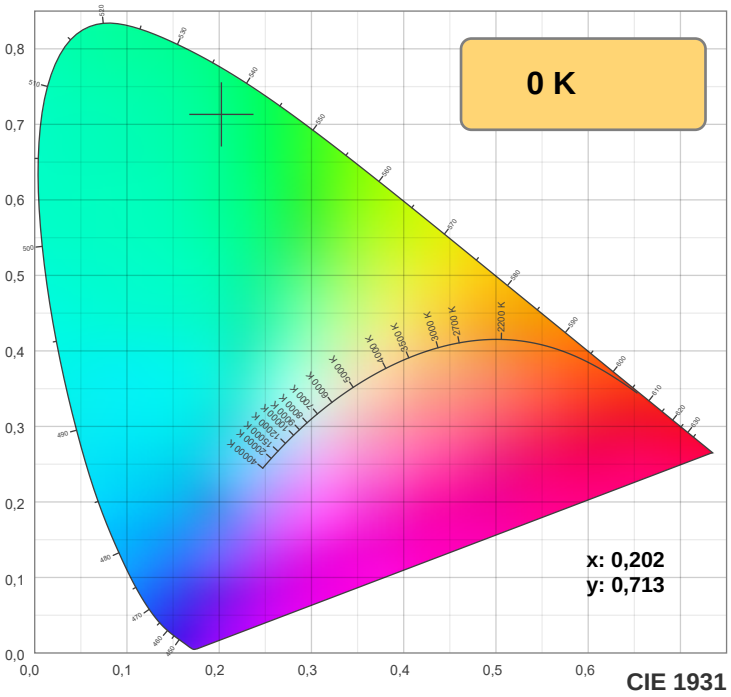


CIE 1931

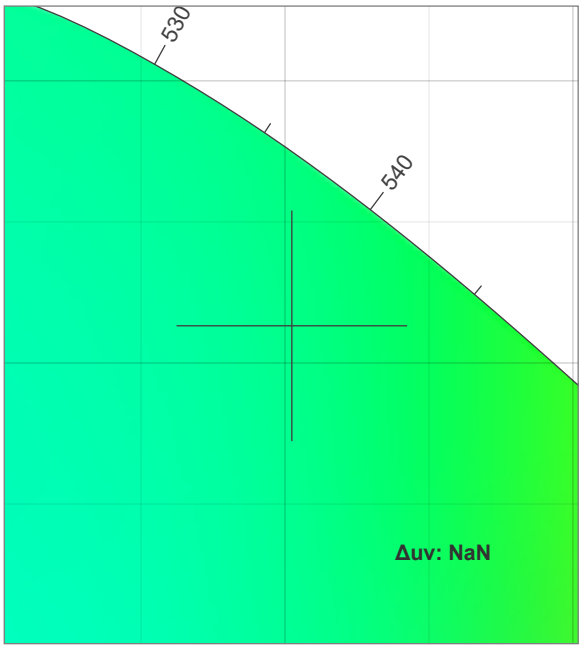


CIE 1931 ZOOM

TM30: 0,0

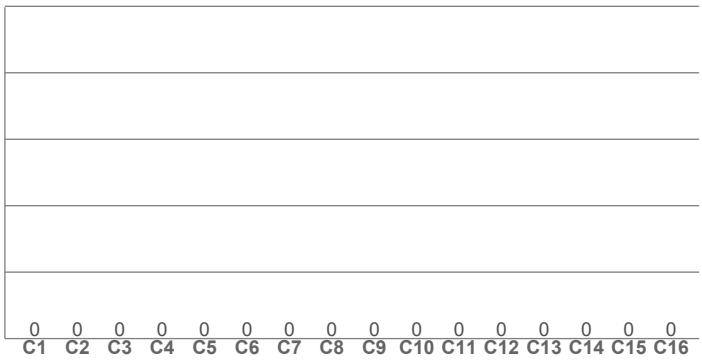

CRI: 0,0 (R1-R8)

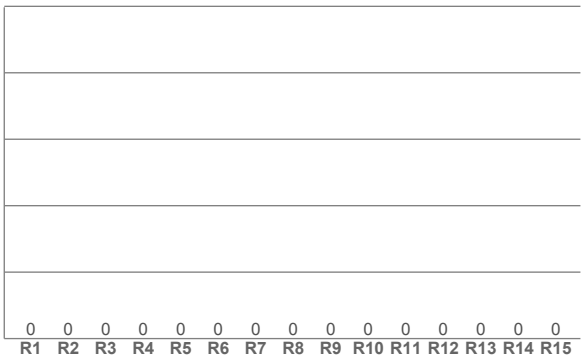

CRI R values, only R1-R8 are used to calculate final CRI value

R1	R2	R3	R4	R5	R6	R7	R8	R9	R10	R11	R12	R13	R14	R15
0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0


TM30 C values, 16 binned values out of total of 99 C values

C1	C2	C3	C4	C5	C6	C7	C8	C9	C10	C11	C12	C13	C14	C15	C16
0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0

CQS Q values

Q1	Q2	Q3	Q4	Q5	Q6	Q7	Q8	Q9	Q10	Q11	Q12	Q13	Q14	Q15
0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0	0,0

CQS: 0,0

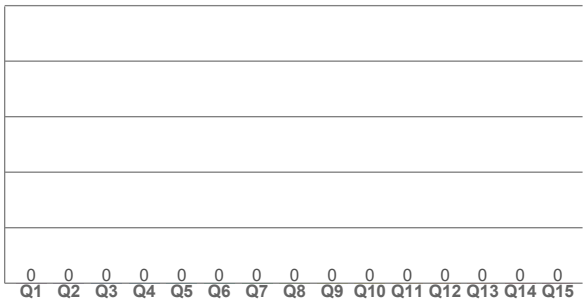

Color parameters

Color temperature	Color rendering index	Red component	Color fidelity	Color gamut	Color quality scale	Color coordinate cie 1931	Color coordinate cie 1931	Color coordinate	Color coordinate	Color diviation from black body
CCT	CRI	CRI R9	TM30 Rf	TM30 Rg	CQS	x	y	u	v	Δuv
0 K	0,0	0,0	0,0	0,0	0,0	0,202	0,713	0,073	0,384	NaN

TM30 details


Rf 0,0

Fidelity index Rf


Rg 0,0

Gammut index Rg


		Graphic shifts (%)	
Hue Bin	R_f	Chroma	Hue
1	0	0%	0%
2	0	0%	0%
3	0	0%	0%
4	0	0%	0%
5	0	0%	0%
6	0	0%	0%
7	0	0%	0%
8	0	0%	0%
9	0	0%	0%
10	0	0%	0%
11	0	0%	0%
12	0	0%	0%
13	0	0%	0%
14	0	0%	0%
15	0	0%	0%
16	0	0%	0%

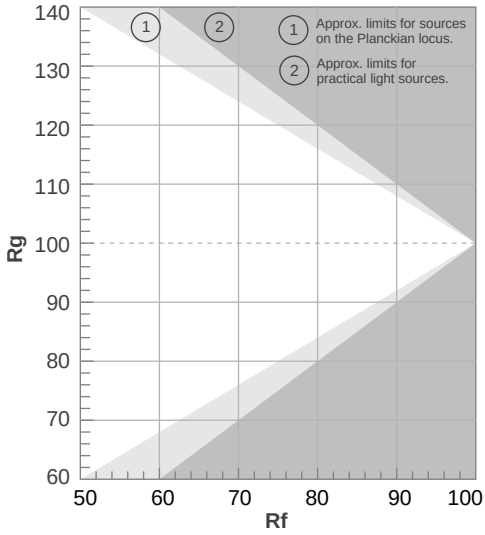




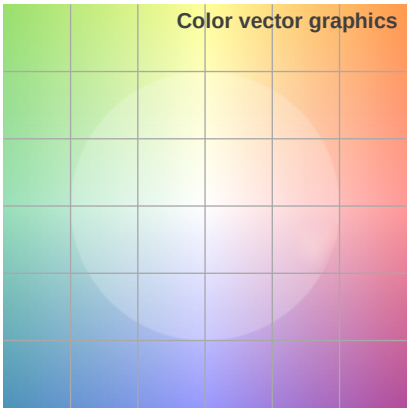




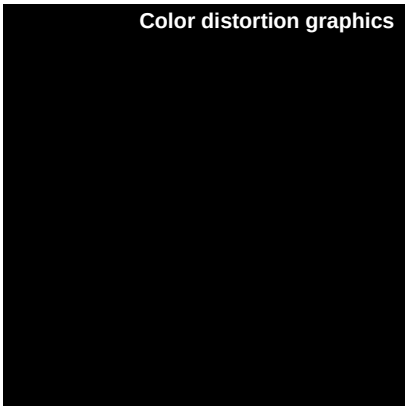

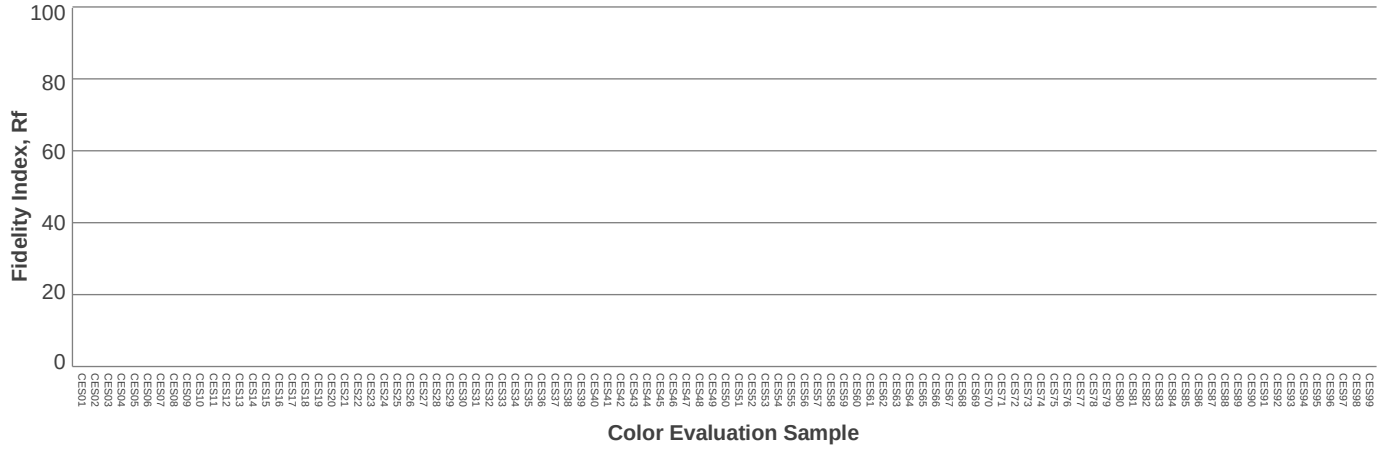

Beam details

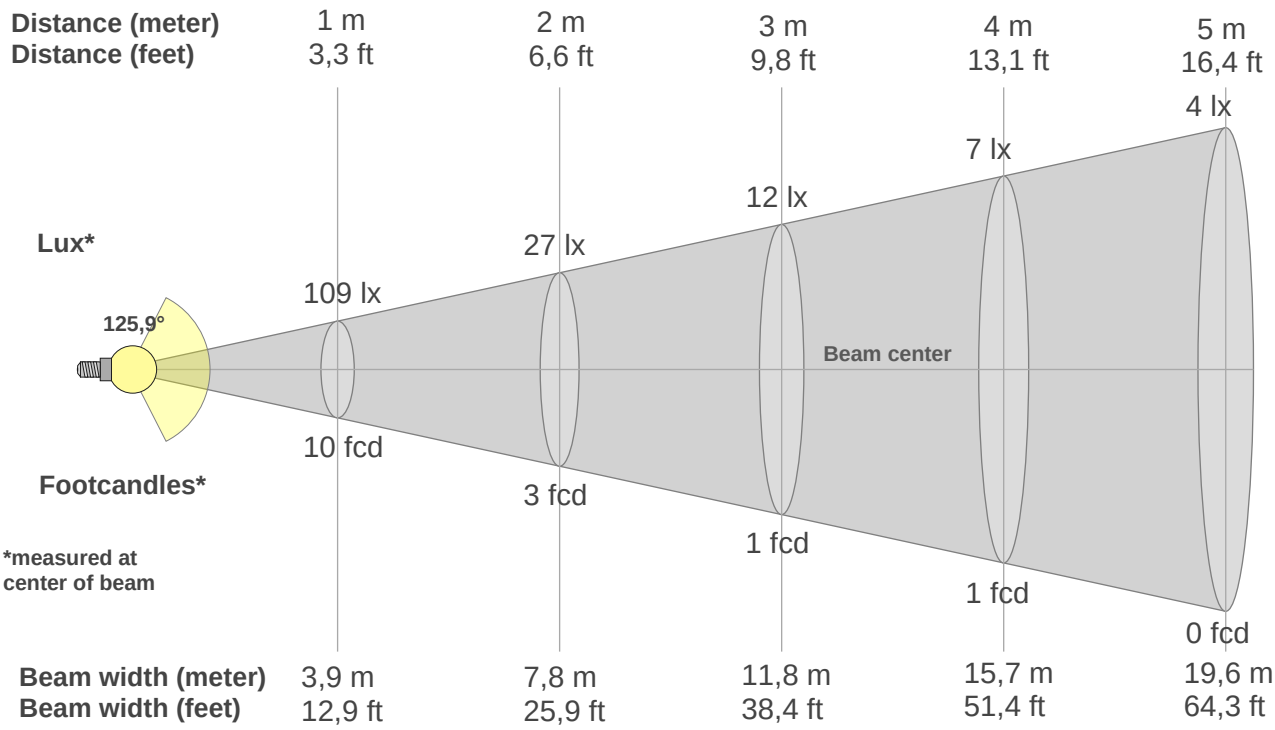

Beam intensities from 1-20m

1m	2m	3m	4m	5m	6m	7m	8m	9m	10m	11m	12m	13m	14m	15m	16m	17m	18m	19m	20m
3,3ft	6,6ft	9,8ft	13,1ft	16,4ft	19,7ft	23ft	26,2ft	29,5ft	32,8ft	36,1ft	39,4ft	42,7ft	45,9ft	49,2ft	52,5ft	55,8ft	59,1ft	62,3ft	65,6ft
109lx	27lx	12lx	7lx	4lx	3lx	2lx	2lx	1lx	1lx	1lx	1lx	1lx	1lx	0lx	0lx	0lx	0lx	0lx	0lx
10,1fcd	2,5fcd	1,1fcd	0,6fcd	0,4fcd	0,3fcd	0,2fcd	0,2fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd	0,1fcd	0fcd	0fcd	0fcd	0fcd	0fcd	0fcd

Intensities in 0° c-plane

0°	9°	18°	27°	36°	45°	54°	63°	72°	81°	90°	99°	108°	117°	126°	135°	144°	153°	162°	171°
109	108	105	99	92	84	76	66	57	48	19	0	0	0	0	0	0	0	0	0
100%	99%	96%	90%	84%	77%	69%	61%	53%	44%	18%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Intensities in 90° c-plane

0°	9°	18°	27°	36°	45°	54°	63°	72°	81°	90°	99°	108°	117°	126°	135°	144°	153°	162°	171°
109	108	104	97	88	76	62	46	29	14	1	1	1	1	1	1	1	0	0	0
100%	99%	95%	89%	80%	69%	57%	42%	27%	12%	1%	1%	1%	1%	1%	1%	0%	0%	0%	0%

Intensities in 180° c-plane


0°	9°	18°	27°	36°	45°	54°	63°	72°	81°	90°	99°	108°	117°	126°	135°	144°	153°	162°	171°
109	108	105	99	92	84	76	66	57	48	19	0	0	0	0	0	0	0	0	0
100%	99%	96%	90%	84%	77%	69%	61%	53%	44%	18%	0%	0%	0%	0%	0%	0%	0%	0%	0%

Intensities in 270° c-plane

0°	9°	18°	27°	36°	45°	54°	63°	72°	81°	90°	99°	108°	117°	126°	135°	144°	153°	162°	171°
109	108	104	97	88	76	62	46	29	14	1	1	1	1	1	1	1	0	0	0
100%	99%	95%	89%	80%	69%	57%	42%	27%	12%	1%	1%	1%	1%	1%	1%	0%	0%	0%	0%

Beam angle 50%	Field angle 10%	Cutoff angle 2,5%	Intensity ratio in 120° cone	Intensity ratio in 90° cone
125,9°	**220°**	**314,6°**	**62,3%**	**40,5%**

ISO candela diagram

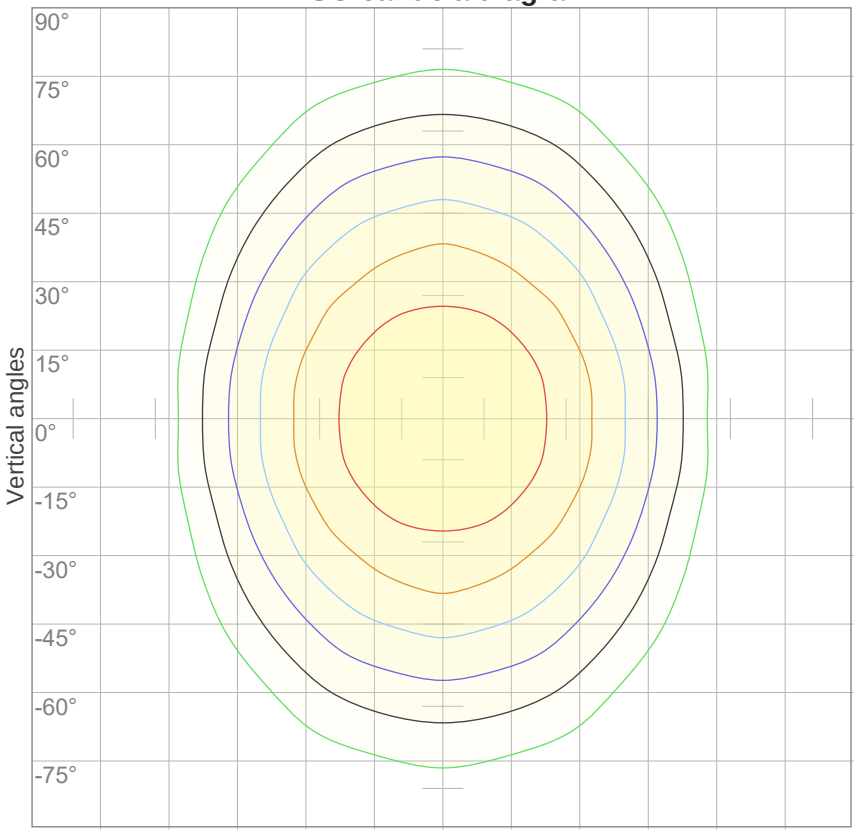


10%	11 cd
20%	22 cd
30%	33 cd
40%	44 cd
50%	55 cd
60%	65 cd
70%	76 cd
80%	87 cd
90%	98 cd

Conditions:

Number of c-planes: 16

Candela at center: 109 cd

ISO lux diagram

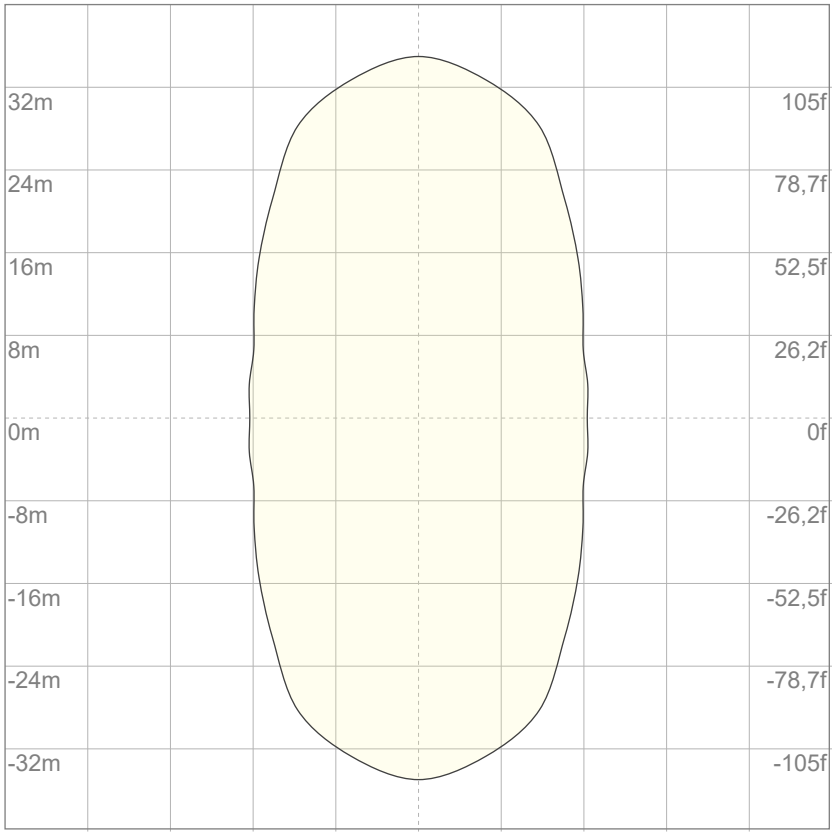

Mounting height: 10 meters (33 feet)

3%	32,7m lx
5%	54,6m lx
10%	0,109 lx
30%	0,327 lx
50%	0,546 lx

Conditions:

Number of c-planes: 16

Lux at center: 1,09 lx

Lux distribution on a surface when lamp is mounted at 10 meters from the surface.

Glare Evaluation According to UGR


p Ceiling		70	70	50	50	30	70	70	50	50	30
p Walls		50	30	50	30	30	50	30	50	30	30
p Floor		20	20	20	20	20	20	20	20	20	20
Room size X	Y	Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis				
2H	2H	19,1	20,5	19,4	20,8	21,0	19,0	20,4	19,3	20,7	20,9
	3H	21,1	22,6	21,6	22,9	23,1	20,6	22,0	21,0	22,3	22,6
	4H	22,2	23,6	22,6	23,9	24,1	21,4	22,7	21,8	23,0	23,3
	6H	23,3	24,5	23,6	24,8	25,2	22,0	23,2	22,3	23,5	23,9
	8H	23,8	25,0	24,2	25,3	25,7	22,2	23,4	22,5	23,7	24,1
	12H	24,3	25,4	24,7	25,8	26,2	22,3	23,5	22,7	23,8	24,3
4H	2H	19,8	21,1	20,2	21,4	21,7	19,7	21,1	20,1	21,3	21,6
	3H	22,2	23,3	22,5	23,6	24,1	21,6	22,8	22,0	23,1	23,6
	4H	23,3	24,4	23,8	24,8	25,3	22,4	23,5	22,9	23,9	24,5
	6H	24,5	25,6	25,0	25,9	26,3	23,1	24,2	23,6	24,5	24,9
	8H	25,1	26,1	25,6	26,5	26,8	23,4	24,4	23,9	24,7	25,1
	12H	25,7	26,5	26,2	27,0	27,4	23,6	24,5	24,1	24,9	25,4
8H	4H	23,7	24,6	24,2	25,0	25,4	22,9	23,9	23,4	24,3	24,7
	6H	25,2	25,9	25,7	26,4	27,0	23,9	24,7	24,4	25,1	25,7
	8H	26,0	26,6	26,5	27,2	27,8	24,3	25,0	24,8	25,5	26,2
	12H	26,7	27,3	27,3	27,8	28,4	24,7	25,3	25,3	25,8	26,4
12H	4H	23,7	24,5	24,2	25,0	25,5	23,1	23,9	23,5	24,3	24,8
	6H	25,3	26,0	25,8	26,5	27,2	24,1	24,8	24,7	25,3	26,0
	8H	26,2	26,7	26,7	27,2	27,9	24,6	25,2	25,2	25,7	26,3
Variation of the observer position for the luminaire distance S											
S = 1.0H		0,1 / 0,0					0,0 / 0,0				
S = 1.5H		0,1 / -0,1					0,1 / -0,1				
S = 2.0H		0,2 / -0,2					0,3 / -0,3				
Standard table		n/a					n/a				
Correction summand		n/a					n/a				
Corrected glare indices referring to 424 lm total luminous flux											

Coefficients of Utilization

Ceiling reflectance	80				70				50			30			10			0
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio)				Room Values are expressed as percentage of Lumens delivered to the task surface													
0	117	117	117	117	114	114	114	114	107	107	107	101	101	101	95	95	95	92
1	104	98	93	88	100	95	90	86	89	85	82	84	81	78	79	76	74	71
2	94	84	76	69	90	81	74	68	76	70	65	72	67	62	68	64	60	57
3	85	73	64	56	81	71	62	55	66	59	53	62	56	51	59	54	50	47
4	77	64	54	47	74	62	53	46	58	51	45	55	49	43	52	46	42	39
5	71	57	47	40	68	55	46	39	52	44	38	49	42	37	47	41	36	33
6	65	51	41	35	63	49	41	34	47	39	33	44	37	32	42	36	31	29
7	60	46	37	30	58	45	36	30	42	35	29	40	33	28	38	32	28	25
8	56	42	33	27	54	41	32	26	39	31	26	37	30	25	35	29	25	22
9	52	38	30	24	50	37	29	24	36	28	23	34	27	23	32	26	22	20
10	49	35	27	22	47	34	27	21	33	26	21	31	25	20	30	24	20	18

Luminaire budgetary diagram

LAMPS (number of lamps)

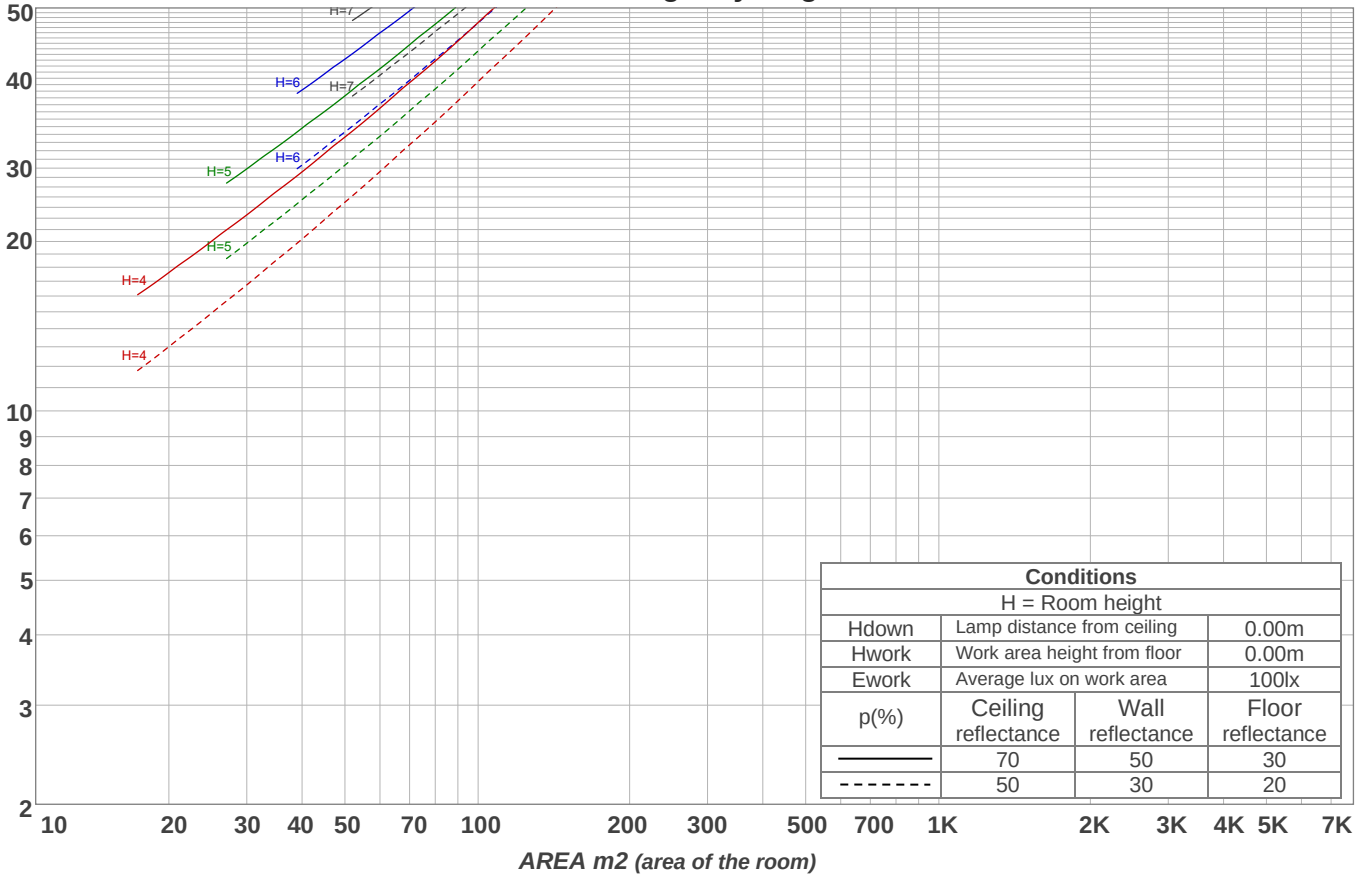


Conditions			
H = Room height			
Hdown	Lamp distance from ceiling		0.00m
Hwork	Work area height from floor		0.00m
Ework	Average lux on work area		100lx
p(%)	Ceiling reflectance	Wall reflectance	Floor reflectance
———	70	50	30
- - - - - - -	50	30	20

Zonal Lumen Summary

0°-10°	10°-20°	20°-30°	30°-40°	40°-50°	50°-60°	60°-70°	70°-80°	80°-90°
10,1 lm	29,3 lm	45,8 lm	56,9 lm	60,8 lm	61,5 lm	53,2 lm	43,5 lm	30,3 lm

90°-100°	100°-110°	110°-120°	120°-130°	130°-140°	140°-150°	150°-160°	160°-170°	170°-180°
2,03 lm	5,10 lm	9,79 lm	0,878 lm	0,686 lm	0,508 lm	0,374 lm	0,229 lm	13,1 lm

Warmup curve

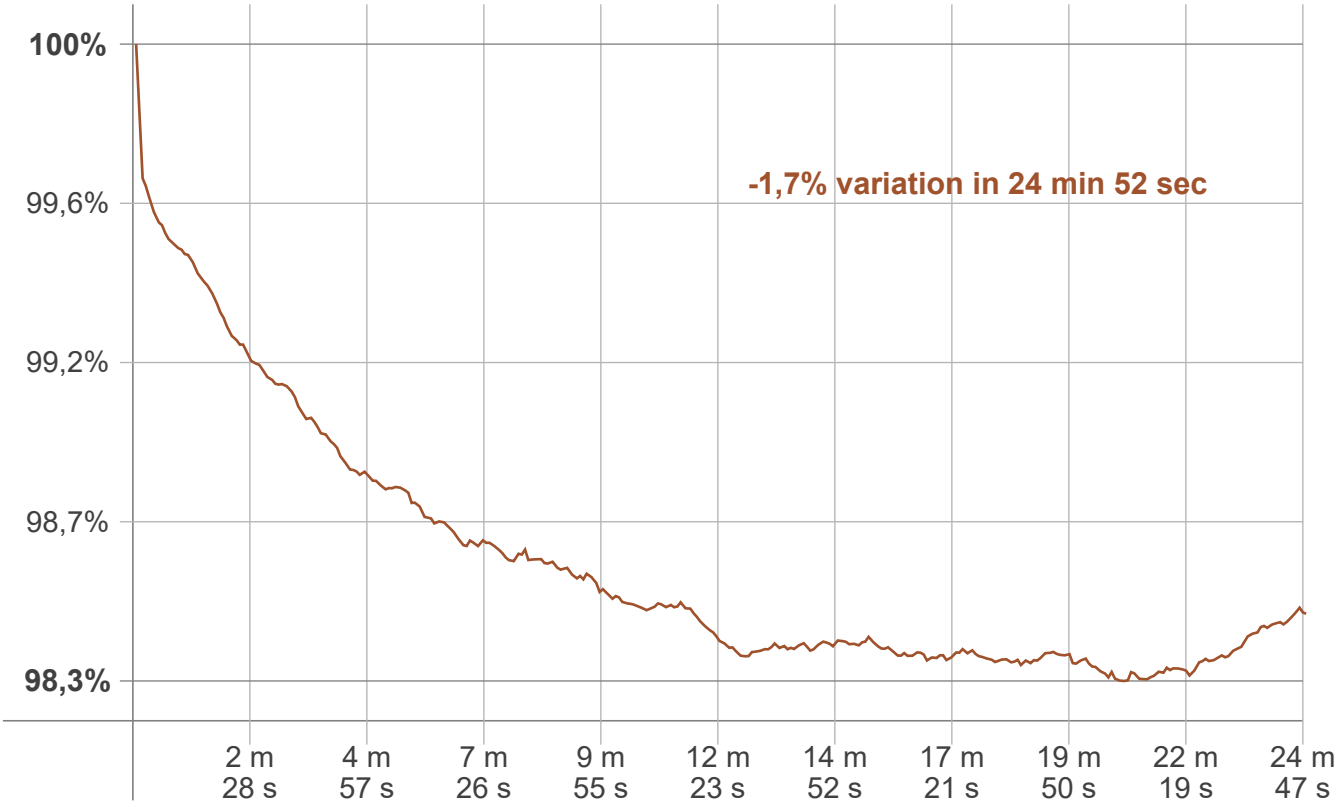

Warmup result

Warmup time:	**Lamp stabilized in 24 min 52 sec**
Warmup variation	**-2,3%**

Warmup conditions

Stable period:	**15 min**
Stable change max:	**2,0%**
Minimum time:	**15 min**

Color temperature change

CCT start	CCT change	CCT end
0 K	0 K	0 K

Output change

Output start	Output change	Output end
444 lm	-20 lm	424 lm